



BSL NEW ENERGY TECHNOLOGY CO., LTD

User Manual

ESS-BATT R60 Series

Copy Right @ BSL New Energy Technology Co., Ltd.

Notice:

The products, services, etc. you purchase shall be subject to the commercial contracts and terms of BSL New Energy Technology Co., Ltd. All or part of the products and services described in this document may not be within the scope of your purchase or use. Unless otherwise specified in the contract, BSL New Energy makes no express or implied representations or warranties regarding the contents of this document.

Due to product version upgrades or other reasons, the content of this document will be updated from time to time. Unless otherwise agreed, this document is only used as a guide, and all statements, information and suggestions in this document do not constitute any express or implied warranty.

Version History

[illegible]

Catalogue

01 Safety Instructions 1

1.1 Safety Symbols	1
1.2 General Security	1
1.3 Personal safety	3
1.4 Battery leakage treatment measures	4
1.5 Electrical safety	5
1.5.1 General requirements	5
1.5.2 Wiring requirements	5
1.5.3 Grounding requirements	6
1.5.4 Maintenance requirements	6
1.6 Mechanical safety	6
1.7 Maintenance and Replacement	7

02 Product Introduction 8

2.1 Product Overview	8
2.2 Model Description	8
2.3 Product Appearance	9
2.4 Product parameters	9
2.5 Product Details	11
2.6 Product Application	14

03 Product Installation 15

3.1 Storage before installation	15
3.2 Pre-installation inspection	16
3.3 Installation Environment	16
3.4 Prepare tools	19
3.5 Mechanical Installation	20

3.6 Electrical connections	23
3.6.1 Single battery system	24
3.6.2 Cluster Battery System	25
3.6.3 Protective ground connection	26
3.6.4 Power line connection	27
3.6.5 External communication line connection	30
3.6.6 External connection lines	32
3.6.7 Electrical system connection	32

04 Operation and maintenance33

4.1 Check before power on	33
4.2 Boot steps	34
4.3 Shutdown steps	35
4.4 Mobile APP	36
4.5 PC-side cloud platform	38
4.6 Battery Display	39
4.7 Battery Failure Handling	40
4.8 Inspection and maintenance	42
4.9 Host computer monitoring	43

05 Warranty Service45

5.1 Warranty Period	45
5.2 Warranty Scope	45
5.3 Disclaimer	45

Appendix46

Appendix A – Emergency Handling	46
Appendix B-Marking Description	48
Appendix C – System Connection Diagram	49

01 Safety Instructions

1.1 Safety Symbols

When installing, operating and maintaining the equipment, please read this manual first and follow all safety precautions marked on the equipment and in the manual. **To ensure that users can better use this product and protect personal and property safety, please read the following symbols carefully.**



DANGER: Indicates a potentially hazardous situation which, if not avoided, will result in death or serious injury.



WARNING: Indicates a situation with a moderately hazardous situation which, if not avoided, could result in death or serious injury.



CAUTION: Indicates a situation with a low risk of hazard which, if not avoided, may result in moderate or minor injury.



Note: Emphasis and supplementation of content may also provide tips for optimal use of the product.

1.2 General Security



Illustrate:

This equipment should be used in an environment that meets the design specifications. Otherwise, it may cause equipment failure. The resulting equipment malfunction or component damage, personal safety accidents, property losses, etc. are not within the scope of equipment quality assurance. Local laws, regulations and specifications should be followed when installing, operating and maintaining the equipment. The safety precautions in the manual are only used as a supplement to local laws, regulations and specifications. The company does not assume responsibility for any of the following situations.

1. The installation and use environment exceeds the requirements of relevant international, national and regional standards.
2. Operation not within the conditions of use described in this manual.
3. Unauthorized disassembly, modification of products or modification of software codes.

4. Failure to follow the operating instructions and safety warnings in the product and documentation.
5. Equipment damage caused by abnormal natural environment (force majeure, such as earthquake, fire, storm, flood, mudslide, etc.).
6. Damage caused by the customer's failure to comply with transportation and installation requirements.
7. Damage caused by storage conditions not meeting the requirements of product documentation.
8. Damage to the hardware or data of the device due to customer negligence, improper operation or intentional damage .
9. System damage caused by a third party or customer , including relocation and installation of the system that does not comply with the requirements of this manual, and damage caused by adjustments, changes or removal of identification marks that do not comply with the requirements of this manual.
10. Defects, failures or damages caused by acts, events, omissions or accidents beyond the reasonable control of the Seller, including power outages or electrical failures, theft, war, riots, civil unrest, terrorism, intentional or malicious damage, etc.



Danger:

The equipment has high voltage. Improper operation may cause electric shock or fire, resulting in death, serious personal injury or serious property loss. Please follow the operation sequence and safety precautions given in this manual and other related documents and operate in accordance with the regulations:

1. Please check whether the pre-installed cables are connected and tightened. Check whether the device is damaged, such as holes, dents, or other signs of possible internal damage. Check that the internal components of the device are not displaced. It is forbidden to change the structure and installation sequence of the device without authorization.
2. It is forbidden to use water to clean the electrical parts inside the equipment. If liquid is found to have entered the equipment, please press the emergency stop switch immediately and notify the on-site management personnel.
3. It is forbidden to install, connect, maintain and replace with power on. Before touching any conductor surface or terminal, measure the voltage at the contact point and confirm that the protective ground wire of the equipment or the part to be repaired is reliably grounded and there is no risk of electric shock.
4. Except for the personnel who operate the equipment, other personnel are not allowed to approach the equipment. Do not power on the equipment before the equipment is installed or confirmed by professionals. When powering on for the first time or operating the main circuit with power on, at least two personnel must be present on site.



Illustrate:

1. The user's operating behaviors and operating tools during transportation, handling, installation, wiring and maintenance must comply with the laws, regulations and relevant standards of the country and region where the user is located.
2. It is prohibited to reverse engineer, decompile, disassemble, adapt, implant or perform other derivative operations on the device software. It is not allowed to study the internal implementation of the device, obtain the source code of the device software, steal intellectual property rights, etc. in any way, and it is not allowed to disclose the results of any device software performance test.

1.3 Personal safety



Danger:

1. During the operation of the equipment, appropriate personal protective equipment should be worn. If a fault that may cause personal injury or equipment damage is found, the operation should be stopped immediately, reported to the person in charge, and effective protective measures should be taken.
2. Before using the tool, please master the correct use of the tool to avoid injury to others and damage to the equipment.
3. When the device is running, some internal shell temperatures are high and there is a risk of burns, so do not touch them.
4. To ensure personal safety and normal use, reliable grounding should be carried out before use.
5. When the battery module fails, the temperature may exceed the burn threshold of the touchable surface and contact should be avoided.
6. Do not open or damage the battery module. The released electrolyte is harmful to the skin and eyes and should be avoided.
7. Do not place irrelevant objects on top of the device or insert them into any part of the device.
8. Do not place flammable items around the device.
9. Batteries are strictly prohibited from being placed in fire to avoid explosion and endangerment to personal safety.
10. Do not place the battery module in water or other liquids.
11. Never short-circuit the battery module terminals. Short-circuiting the battery may cause burns.
12. Batteries may cause danger of electric shock and large short-circuit current.
13. Do not use water or detergent to clean the electrical components inside and outside the device.
14. Do not stand, lean or sit on the equipment.
15. Do not damage the modules of the device.

16. When installing the battery module, if the battery module falls or is hit hard, it will cause damage to the equipment. It is strictly forbidden to continue using it, otherwise there will be safety risks (battery leakage, electric shock, etc.).



Warning:

1. Remove watches, rings or other metal objects.
2. Use tools with insulated handles.
3. Wear rubber gloves and boots.
4. Do not place small tools or metal parts on top of the battery module.
5. Disconnect the charging power source before connecting or disconnecting the battery terminals.
6. Determine if the battery is accidentally grounded. If it is accidentally grounded, remove the power supply from the ground. Contact with any part of the grounded battery may cause electric shock. If these grounds are removed during installation and maintenance, the possibility of this electric shock can be reduced.

1.4 Battery leakage treatment measures



Notice:

When electrolyte leakage occurs, the following emergency measures can be taken depending on the severity of the leakage.

1. Ensure adequate ventilation and eliminate all ignition sources.
2. Quickly evacuate personnel to a safe area, away from the leakage area and in the upwind direction.
3. Use personal protective equipment and avoid inhaling steam, smoke, gas or dust.
4. Take measures to prevent further leakage or overflow while ensuring safety.
5. In case of a small leakage, dry sand or inert adsorbent materials can be used to absorb the leak. In case of a large leakage, a dam must be built to control it.
6. Attachments or collections should be stored in suitable sealed containers and disposed of in accordance with local laws and regulations.
7. Eliminate all ignition sources and use spark-proof tools and anti-riot equipment.



Danger:

In the event of a leak, avoid contact with leaking liquid or gas. The electrolyte is corrosive and contact may cause skin irritation and chemical burns. If you come into contact with battery electrolyte, you need to take the following measures.

1. Inhalation: Evacuate the contaminated area and move to fresh air immediately to keep breathing unobstructed; if breathing is difficult, give oxygen; if the patient ingests or inhales this substance, do not perform

mouth-to-mouth artificial respiration; if breathing stops, immediately perform cardiopulmonary resuscitation; and seek medical help immediately.

2. Eye contact: Immediately rinse eyes with plenty of water for at least 15 minutes, do not rub, and seek medical help immediately.

3. Skin contact: Take off contaminated clothing immediately, wash the skin contact area with plenty of water and soap, and seek medical help immediately.

4. Ingestion: Do not induce vomiting. Never feed anything by mouth to an unconscious person. Seek medical help immediately.

5. Protection of emergency personnel: Ensure that medical personnel understand the hazardous characteristics of the product and take personal protective measures to protect themselves and prevent the spread of contamination.

1.5 Electrical safety

1.5.1 General requirements



Illustrate:

1. All electrical connections must meet the electrical standards of the country/region.
2. You must obtain permission from the power department of the country/region before you can connect to the grid for power generation.
3. User-supplied cables must comply with local laws and regulations.
4. When performing high voltage operations, please use special insulating tools.



Danger: Before making electrical connections, make sure the device is not damaged, otherwise it may cause electric shock or fire.

1.5.2 Wiring requirements

1. Please select cables that comply with local laws and regulations. Cables of the same type should be bundled together, and cables of different types should be laid separately. They should not be entangled or crossed.
2. The cables used in the high-voltage stacking machine must be firmly connected, well insulated, and meet the specifications. The cable conduit or wire hole must be protected to prevent the cables from being damaged by sharp edges, burrs, etc.
3. Using cables in high temperature environments may cause aging and damage of the insulation layer. The distance between the cables and the heating device or the periphery of the heat source area should be at least 30mm.

4. To ensure construction safety, all cables should be laid and installed above 0°C. When moving cables, especially when working in low temperature environments, they should be handled with care.



Danger: It is forbidden to install or remove the power cord while it is powered on. When the power cord core contacts the conductor, an arc or spark will be generated, which may cause fire or personal injury.

1.5.3 Grounding requirements

1. When installing equipment that needs to be grounded, the protective ground wire must be installed first; when dismantling the equipment, the protective ground wire must be removed last.
2. It is prohibited to damage the grounding conductor.
3. It is prohibited to operate the equipment without installing a grounding conductor.
4. The equipment should be permanently connected to the protective ground. Before operating the equipment, check the electrical connection of the equipment to ensure that the equipment is reliably grounded.

1.5.4 Maintenance requirements

1. Before connecting or removing cables, the protection switch of the corresponding circuit must be turned off.
2. Use a multimeter of the corresponding voltage level to check whether it is energized and ensure that the equipment is completely powered off.
3. If there is a charged object nearby, please use an insulating board or insulating tape to cover or wrap it.
4. Use the grounding wire to reliably connect the circuit to be inspected to the grounding circuit before performing operation and maintenance.



Illustrate:

1. Before connecting cables, make sure the cable labels are correct.
2. If the device has multiple inputs, all inputs of the device should be disconnected and the device can be operated only after it is completely powered off.
3. After the inspection is completed, remove the grounding wire between the inspection circuit and the grounding circuit.

1.6 Mechanical safety

1. When moving equipment by hand, you should be prepared to bear the weight and wear protective gloves, anti-smash shoes and other safety protection equipment.
2. Move the equipment carefully during transportation to avoid collision or drop. Avoid scratching the surface of the equipment and damaging parts or cables.

3. When transporting equipment, the large size of the equipment may block the operator's view, so auxiliary personnel need to be arranged to assist.

1.7 Maintenance and Replacement

Please maintain the equipment only after you are familiar with and understand the contents of this manual and have appropriate tools and test equipment.

1. Before performing maintenance work, please power off the device first, then follow the instructions on the delayed discharge label and wait for the corresponding time to ensure that the device is powered off before operating the device.
2. During the maintenance process, please try to avoid irrelevant personnel entering the maintenance site, and temporary warning signs or fences must be erected for isolation.
3. If the equipment fails, please contact your dealer in time.
4. The equipment can be powered on again only after the fault has been resolved. Otherwise, the fault may expand or the equipment may be damaged.
5. Unauthorized persons are not allowed to open the cover without authorization, otherwise there will be a risk of electric shock, and the resulting malfunction is not covered by the warranty.
6. Operators, maintenance personnel and professional technicians should receive adequate training on safe use and equipment maintenance, and should operate with adequate preventive measures and personal protective equipment.
7. When moving or rewiring is required, the power input must be cut off. After waiting for 5 minutes for the internal energy of the machine to be discharged, and after using a multimeter to confirm that there is no dangerous voltage on the DC bus and the parts to be repaired inside the machine, maintenance can be started.
8. Battery maintenance should be performed or supervised by personnel familiar with batteries and the necessary precautions.
9. When replacing batteries, please replace with battery modules of the same type.
10. After the maintenance operation is completed, check immediately to ensure that no tools or other parts are left in the equipment.
11. If the device is not used for a long time, the battery needs to be stored and recharged according to this manual.



Danger:

During the operation of the equipment, there is high voltage, which may cause electric shock, resulting in death, serious personal injury or serious property loss. Therefore, before performing any maintenance work, the equipment must be powered off and the safety precautions listed in this manual and other related documents must be strictly followed.

02 Product Introduction

2.1 Product Overview

The battery system consists of a battery box and a high-voltage control box, and is designed for small commercial and residential energy storage systems. It has high-voltage DC input and output ports, and can store and release high-voltage DC according to the needs of photovoltaic energy storage.

2.2 Model Description

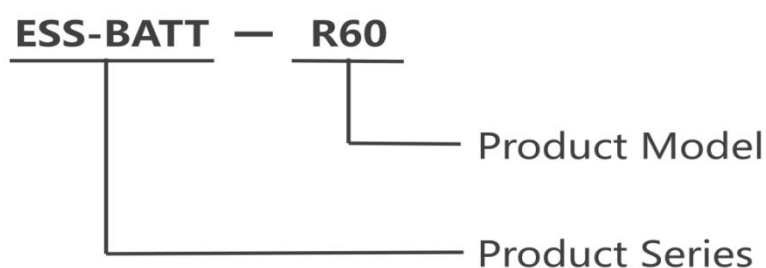


Figure 2.2-1



Description: The ESS-BATT R60 high-voltage stacked battery system can be freely matched according to the number of battery PACKs and the power of a specific inverter, thereby achieving flexible configuration of the rated output power on the AC side; and supports up to 5 groups of ESS-BATT R60 for cluster use.

Serial number	Meaning	Illustrate
1	Product Model	102Ah battery pack (12 pieces) 62kWh battery system (R60)
2	Product Features	High Voltage Rack Mounted Batteries

Table 2.2

2.3 Product Appearance

ESS-BATT R60

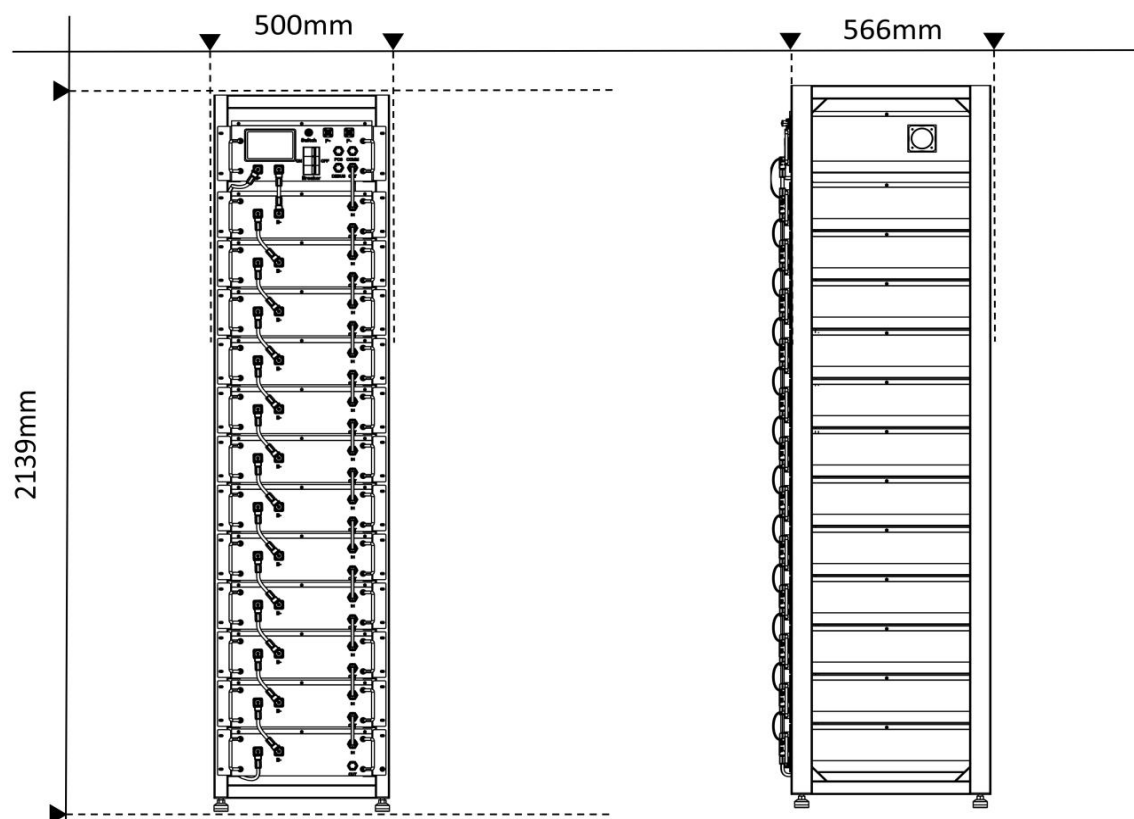


Figure 2.3



Note: The actual height may vary slightly, please refer to the actual installation height ;

2.4 Product parameters

ESS-BATT R60 Technical Parameters

Model	ESS-BATT R60
Battery Pack	
Battery capacity	3.2V/102 Ah
Battery Cell Materials	Lithium Iron Phosphate
Combination	1P16S
Rated voltage	51.2V

Rated current	50A
Rated energy	5.22kWh
Maximum charge and discharge rate	≤1C
Cooling method	Natural cooling
Single package weight	42 kg ±1%
Battery Cluster	
Battery Pack Quantity	12
System rated voltage	614.4V
Operating voltage range	537.6V ~ 691.2V
Recommended voltage range	556.8V ~ 672V
System rated energy	62.6 kWh
Maximum charging current	100A (25±2°C)
Maximum discharge current	100A (25±2°C)
Cycle times	≥5000 times (80 % DOD @25°C, 0.5C)
Other parameters	
Operating temperature range	-20°C~55°C
Storage temperature range	0 °C~ 35 °C
Operating humidity range	15%~90%RH (no condensation)
Altitude	≤2000m
Installation Environment	indoor
PACK fire protection	Optional

Communication Protocol	CAN/ModBus
Protection level	IP20
Dimensions (W x D x H)	500*566*2139mm (±5mm)
weight	590kg±5%

Table 2. 4-1



Illustrate:

It is not recommended to operate the battery at the maximum charge and discharge current for a long time. The rated capacity of the battery is 102Ah at 25°C. The charge and discharge current and power will change according to the temperature and battery SOC.

2.5 Product Details

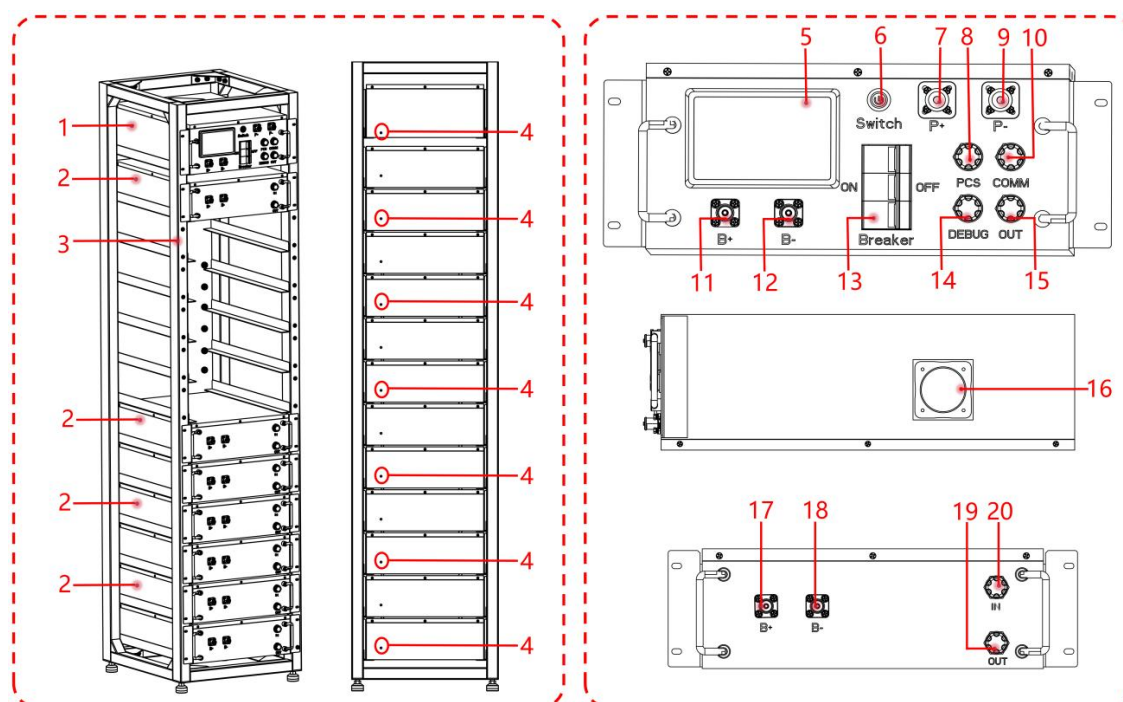


Figure 2.5

NO	Part Name	Illustrate
1	High voltage control box	Control battery system operation

2	Battery Box	102Ah
3	Battery rack	Fixed battery
4	Protective ground terminal	Connect the grounding wire of the battery system
5	Display	Display battery status information
6	Power button	Control the low voltage circuit "on/off" in the battery system
7	Control box positive terminal	Connect the external positive DC cable to the positive pole of the inverter
8	PCS Communication Port	Communication connection between battery and inverter
9	Control box negative terminal	Connect external negative DC cable, which can be connected to the negative pole of the inverter
10	Parallel Communications Port	Communication connection between batteries
11	Control box positive socket	Connect the positive terminal of the battery box
12	Control box negative socket	Connect the negative terminal of the battery box
13	DC circuit breaker	Control the on/off of the battery high voltage circuit

14	Debug Port	Used to communicate with the computer to monitor and upgrade the battery
15	Control box internal communication port	Communication port between BMU and BCU in battery system
16	4G&Wifi Antenna	For remote monitoring
17	Battery box positive socket	Connect to the positive pole of the control box or the negative pole of the upper battery box
18	Battery box negative socket	Connect the negative pole of the control box or the positive pole of the lower battery box
19	Battery box communication output port	Output of BMU in battery system
20	Battery box communication input port	Input of BMU in battery system

Table 2.5

2.6 Product Application

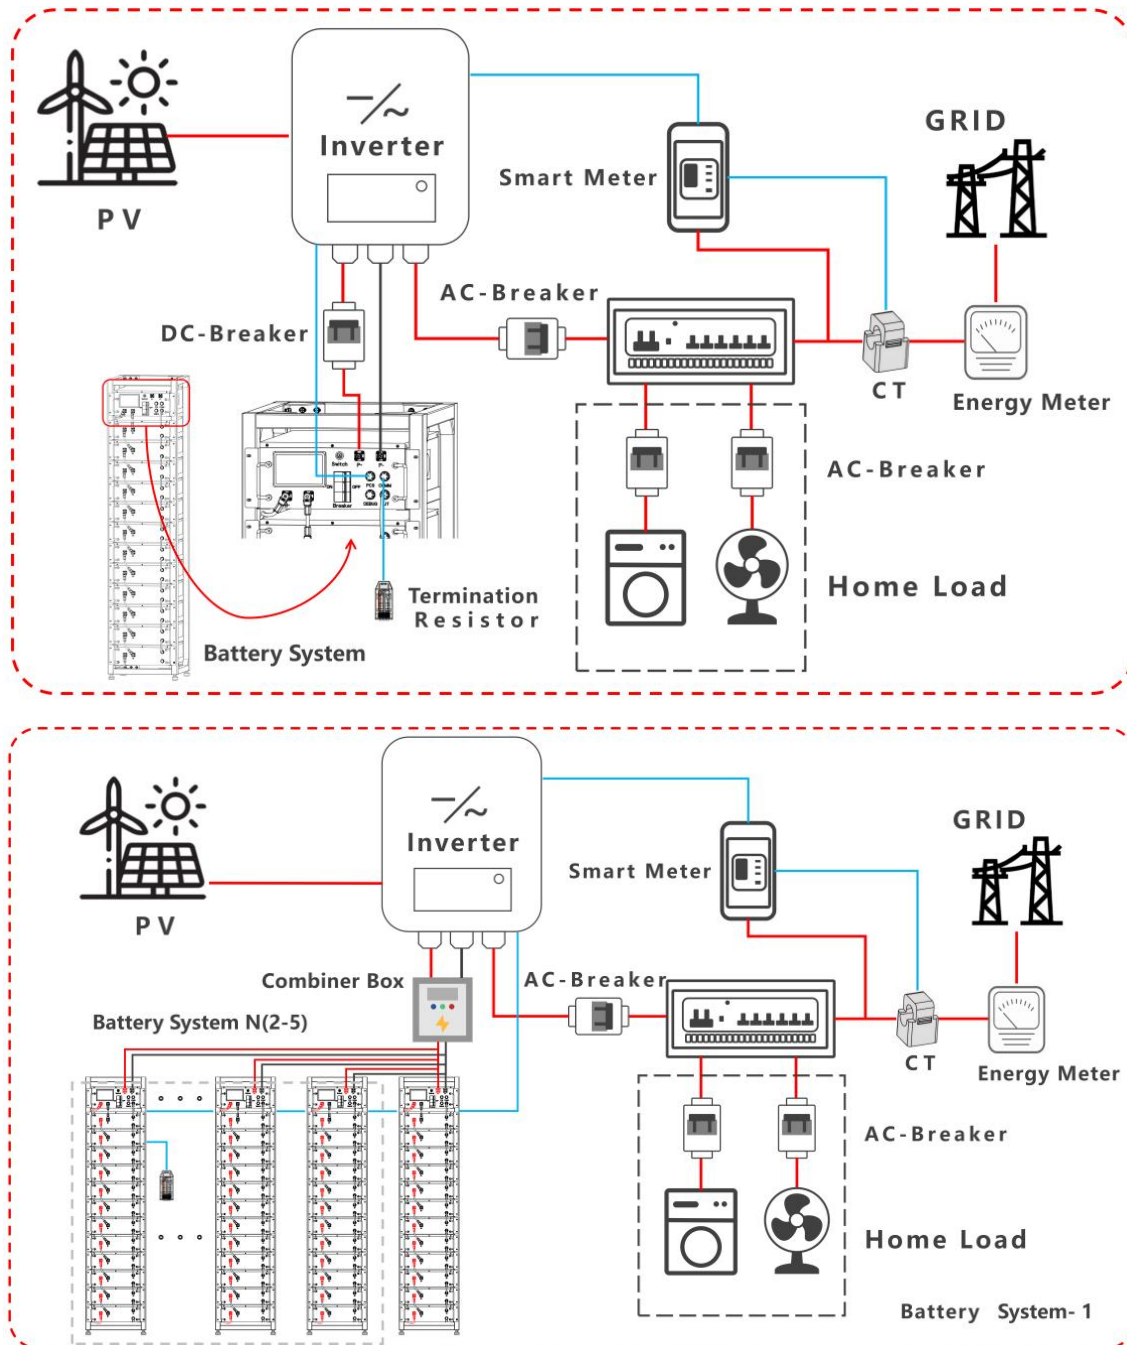


Figure 2.6



Note: The circuit breakers between the inverter and the battery, and between the battery systems should be installed in accordance with local laws and regulations.

03 Product Installation

3.1 Storage before installation

1. Preparation before **storage** : Make sure the outer packaging box of the equipment is intact and do not dismantle it ; make sure the desiccant in the box is not lost to keep the inside dry.
2. **Storage environment requirements**: When storing the equipment, keep it away from flammable, explosive, corrosive and other items ; store the equipment in a cool place and avoid direct sunlight ; ensure that the storage environment is clean, the temperature and humidity range is appropriate, and there is no condensation.
3. **Battery storage requirements**: The SOC (state-of-charge) range of the stored battery should be 25%~50% SOC ; the battery needs to be charged and discharged once every 6 months of storage.
4. **Storage temperature range**: When the temperature is between -10 °C and 0°C, the storage time shall not exceed 1 month ; when the temperature is between 0°C and 35°C, the storage time shall not exceed 1 year ; when the temperature is between 35°C and 45°C, the storage time shall not exceed 1 month.
5. **Storage humidity range**: The storage humidity range is 15 ~ 90 % RH, without condensation . If moisture and condensation are found on the battery interface, the battery system cannot be installed and should be handled

properly.

3.2 Pre-installation inspection

1. **Outer packaging inspection:** Verify whether the outer packaging is intact, including whether there are deformations, holes, cracks or other signs that may cause damage to the internal equipment.
2. **Equipment model and delivery parts inspection:** Check whether the equipment model is consistent with the order ; confirm whether the type and quantity of the delivery parts are correct, and check whether there is any damage on the appearance.

3.3 Installation Environment

- 1、 **Installation environment requirements:** The equipment must not be installed in a flammable, explosive, or corrosive environment ; the installation location should be out of reach of children and should be located in a location that is not easily touched accidentally ; at the same time , note that the surface of the equipment may generate high temperatures when it is running to prevent burns.

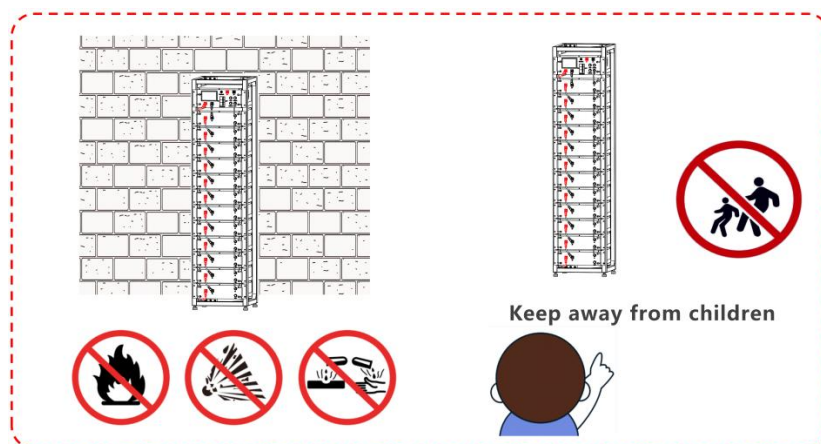


Figure 3.3-1

2、 **Notes on the installation location:** Avoid installing near water pipes, cables, etc. inside the wall to prevent damage to the battery . The installation environment should avoid direct sunlight, rain, and snow. It is recommended to install it in a well-ventilated place indoors . If necessary, install an air-cooled air conditioner.

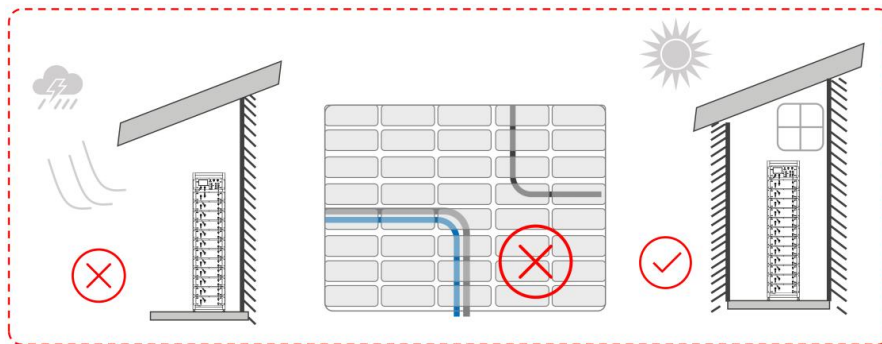


Figure 3.3-2

3、 **Installation space and environmental conditions:** Ensure that the installation space meets the ventilation and heat dissipation and operating space requirements of the equipment ; the protection level of the equipment is suitable for indoor installation, and the temperature and humidity of the installation environment must be kept within an appropriate range.

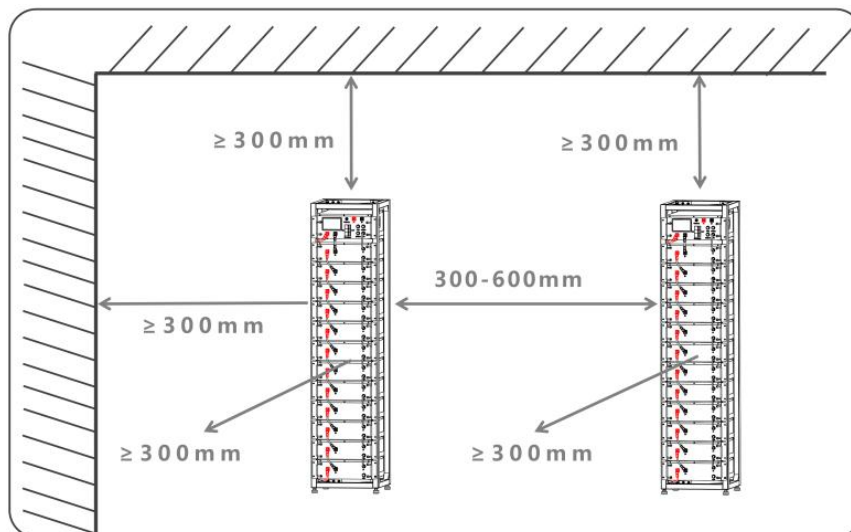


Figure 3.3-3

4. Equipment installation height and protection: The equipment installation height should be convenient for operation and maintenance, ensuring that indicator lights and labels are clearly visible and wiring terminals are easy to operate ; the equipment installation altitude should not exceed 2,000 meters.

5. Electromagnetic interference protection: The installation location should be away from strong magnetic fields to avoid interference ; if there are radio stations or wireless communication devices below 30MHz near the installation location, the distance between the battery and these devices should be greater than 30 meters.

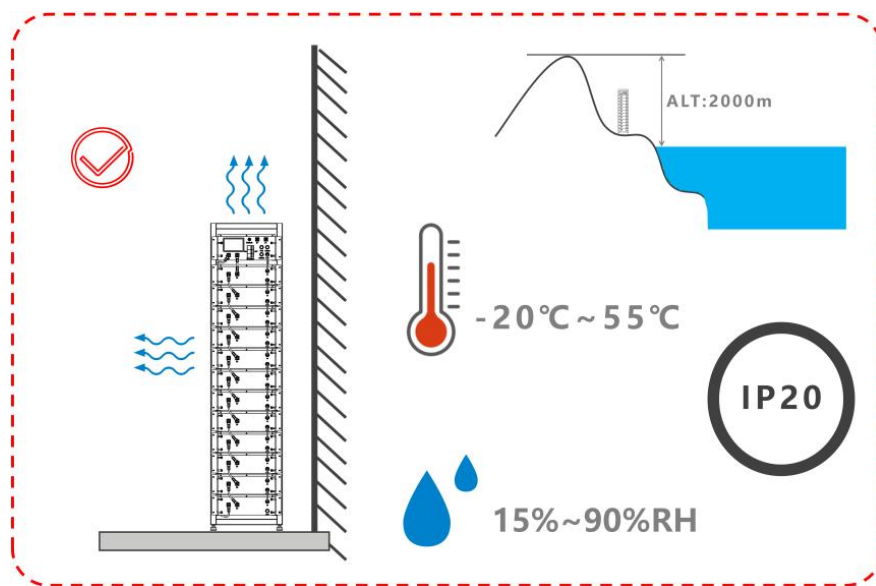


Figure 3.3-4

6. Requirements for installation carrier: Use non-flammable materials (such as concrete, masonry, or fire-resistant wood or metal) ;

The carrier must be sturdy and able to bear the weight of the equipment ; the battery system must be installed against the wall and equipped with an anti-dump bracket.

7、 Installation angle requirements: The device must be installed horizontally to

avoid tilting or inverting.

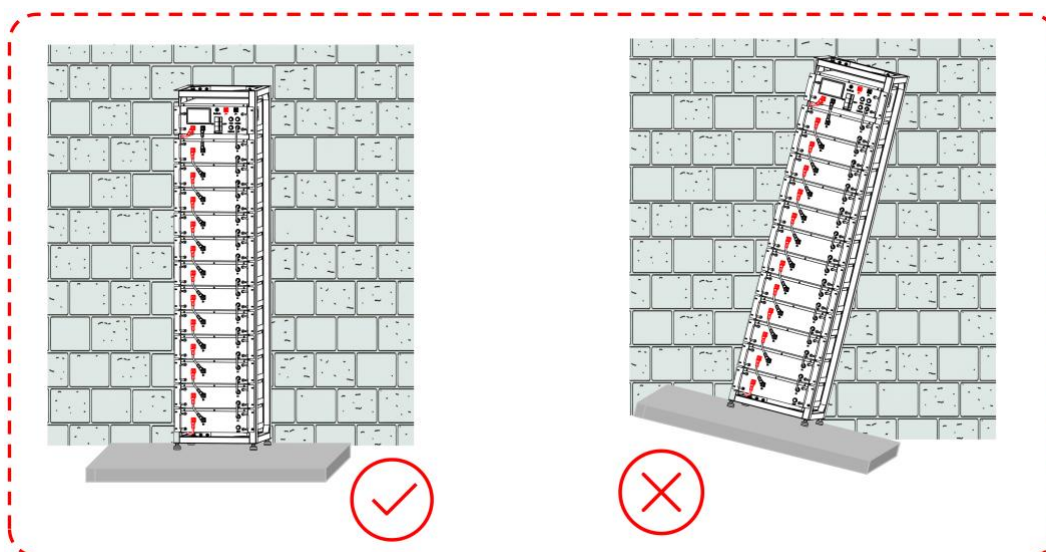


Figure 3.3-5

3.4 Prepare tools

Installation Tool Table

NO.	Tool Name	legend
1	Insulating gloves	
2	Protective glasses	
3	Insulated shoes	
4	Work clothes	
5	helmet	
6	screwdriver	
7	Wire strippers	

8	Hydraulic pliers
9	Heat Gun
10	multimeter
11	Torque wrench
12	Marking pen



Table 3.4



Note: This table is for reference only. The actual tools should be based on local installation standards.

3.5 Mechanical Installation



Notice:

1. During transportation, handling and installation, local laws, regulations and industry standards must be observed;
2. Arrange the transporters appropriately according to the weight of the battery to prevent injuries caused by overweight handling; at the same time, be sure to wear safety gloves to protect your hands;
3. Please ensure that the battery remains balanced during transportation to avoid falling.

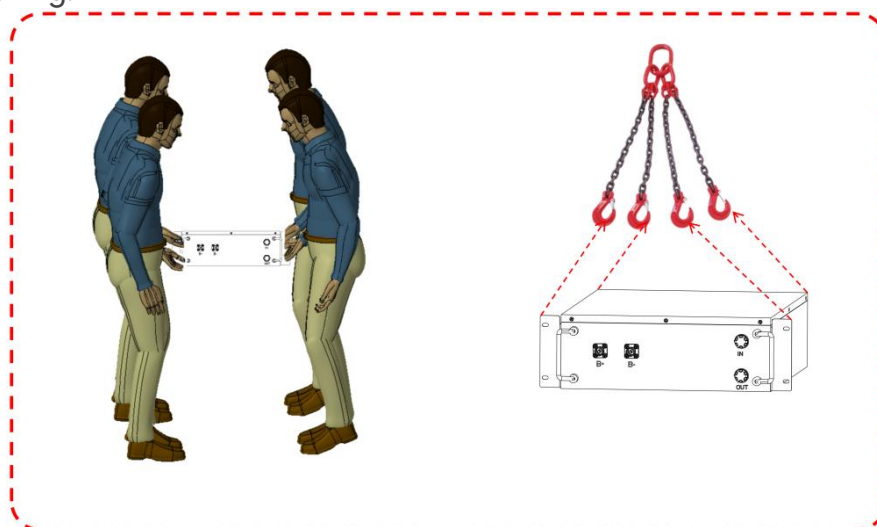


Figure 3.5-1



Note: During the installation process, ensure that there are at least 2 to 4 people operating to ensure safety.

Battery system installation:

Step 1:

Adjust the four adjustable feet under the supporting battery base and operate the nuts with a wrench to ensure that the battery base is firmly fixed on the carrier of non-flammable materials;

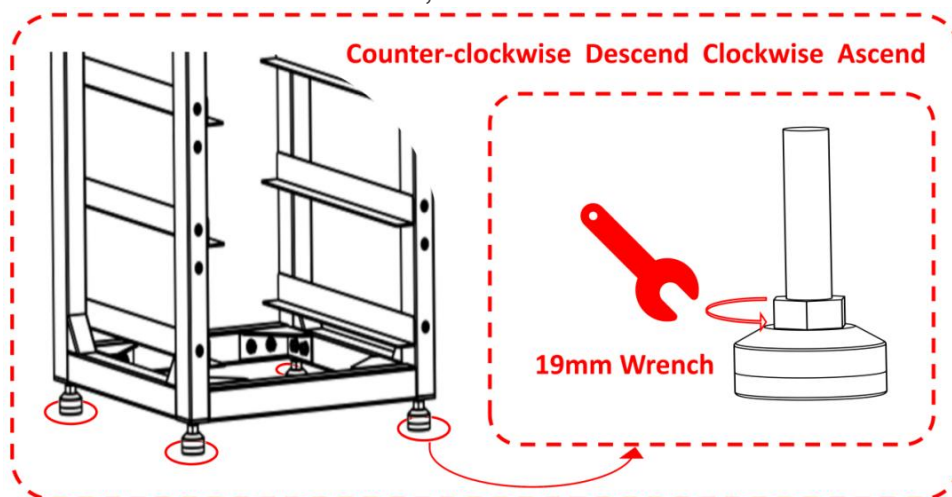
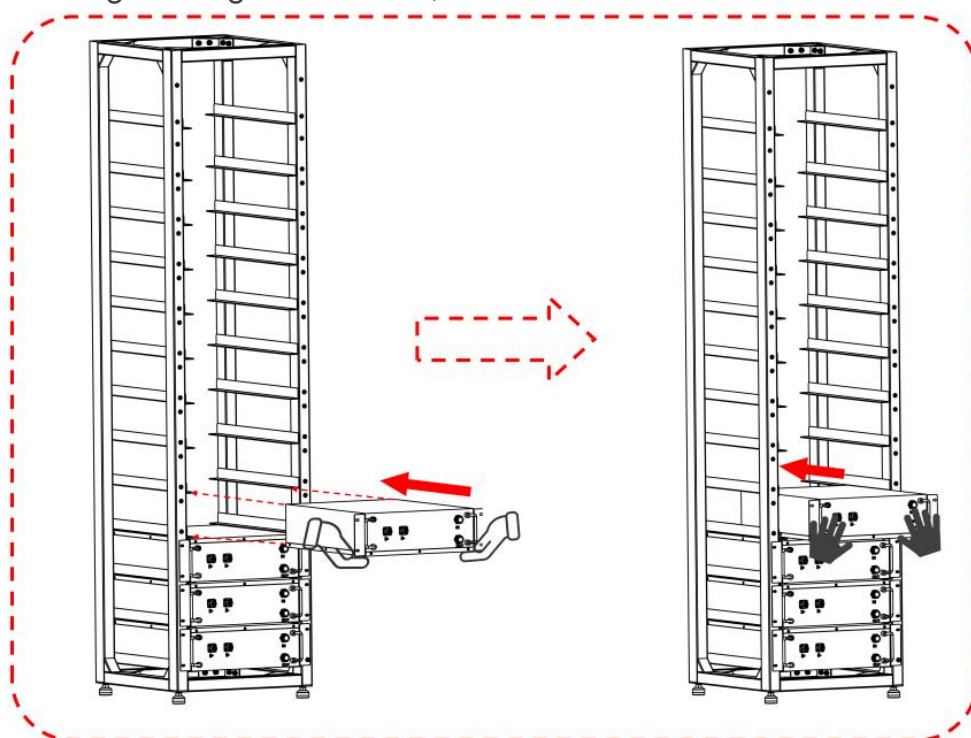


Figure 3.5-2

Step 2:

Place the battery packs in the installation rack from bottom to top, and make sure that each layer of battery boxes is completely inside the rack, and then place the high-voltage control box;



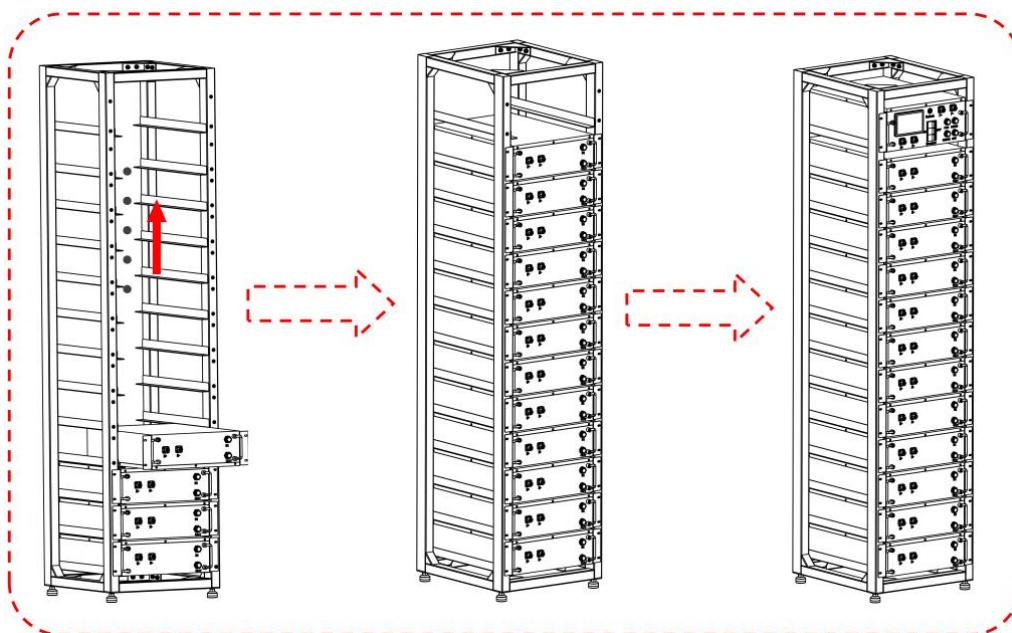


Figure 3.5-3

Step 3:

Use M6 bolts to fasten the four mounting holes on each layer of battery boxes and the high-voltage control box to the battery rack to ensure reliable mechanical fixation of the battery system;

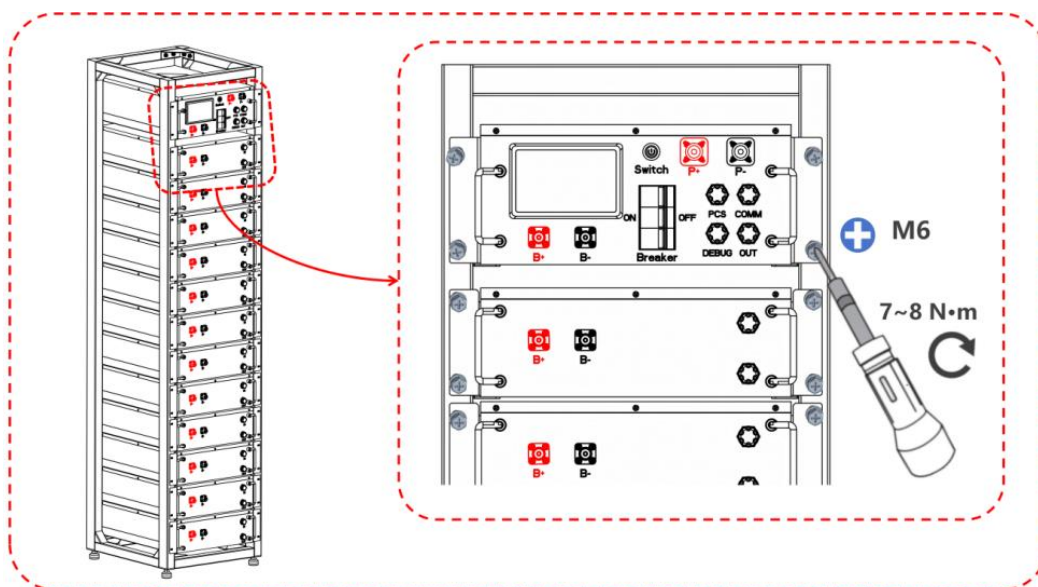


Figure 3.5-4



Notice: During battery installation, always wear insulating gloves to prevent electric shock.

Step 4:

After the battery system is installed, check whether it is installed horizontally and firmly. If it is tilted or wobbly, adjust the installation status of the battery system by rotating the adjustment feet.

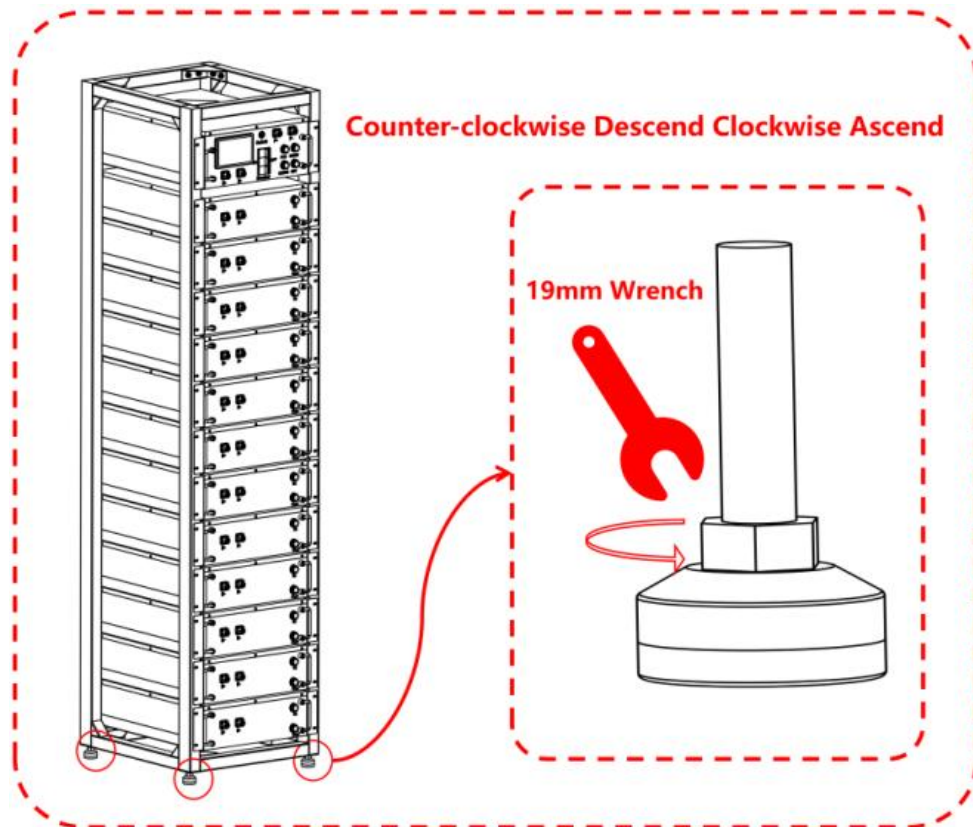


Figure 3.5-7

**Notice:**

Make sure the control box is always located above the battery. Do not install the battery on top of the control box. When placing the battery box or control box, make sure the left and right holes are aligned.

3.6 Electrical connections

**Danger:**

1. Safe power-off operation

Before performing any operation on the equipment in the battery system, make sure that the equipment is completely powered off to prevent electric shock accidents ;

Strictly comply with the safety precautions in this manual and the safety signs on the equipment ;

2. Electrical connection specifications

During electrical connections, cables and component specifications that comply with local laws and regulations must be used ;

Cables of the same type should be bundled together and laid out separately from cables of different types to prevent them from getting tangled or crossed.

3. Precautions for crimping terminal blocks

When crimping the terminal, you must ensure that the conductor part of the cable is in full contact with the terminal ;

It is strictly forbidden to crimp the cable insulation together with the terminal block. Doing so may cause the equipment to fail to operate normally, or generate heat due to unreliable connection during operation, thereby damaging the inverter terminal block.



Notice:

1. Electrical connection operations are limited to professionals ;
2. The cable colors shown in the figure are for reference only. In actual operation, they should be selected according to specific circumstances ;
3. Ensure that the cable specifications used comply with local laws and regulations .

3.6.1 Single battery system

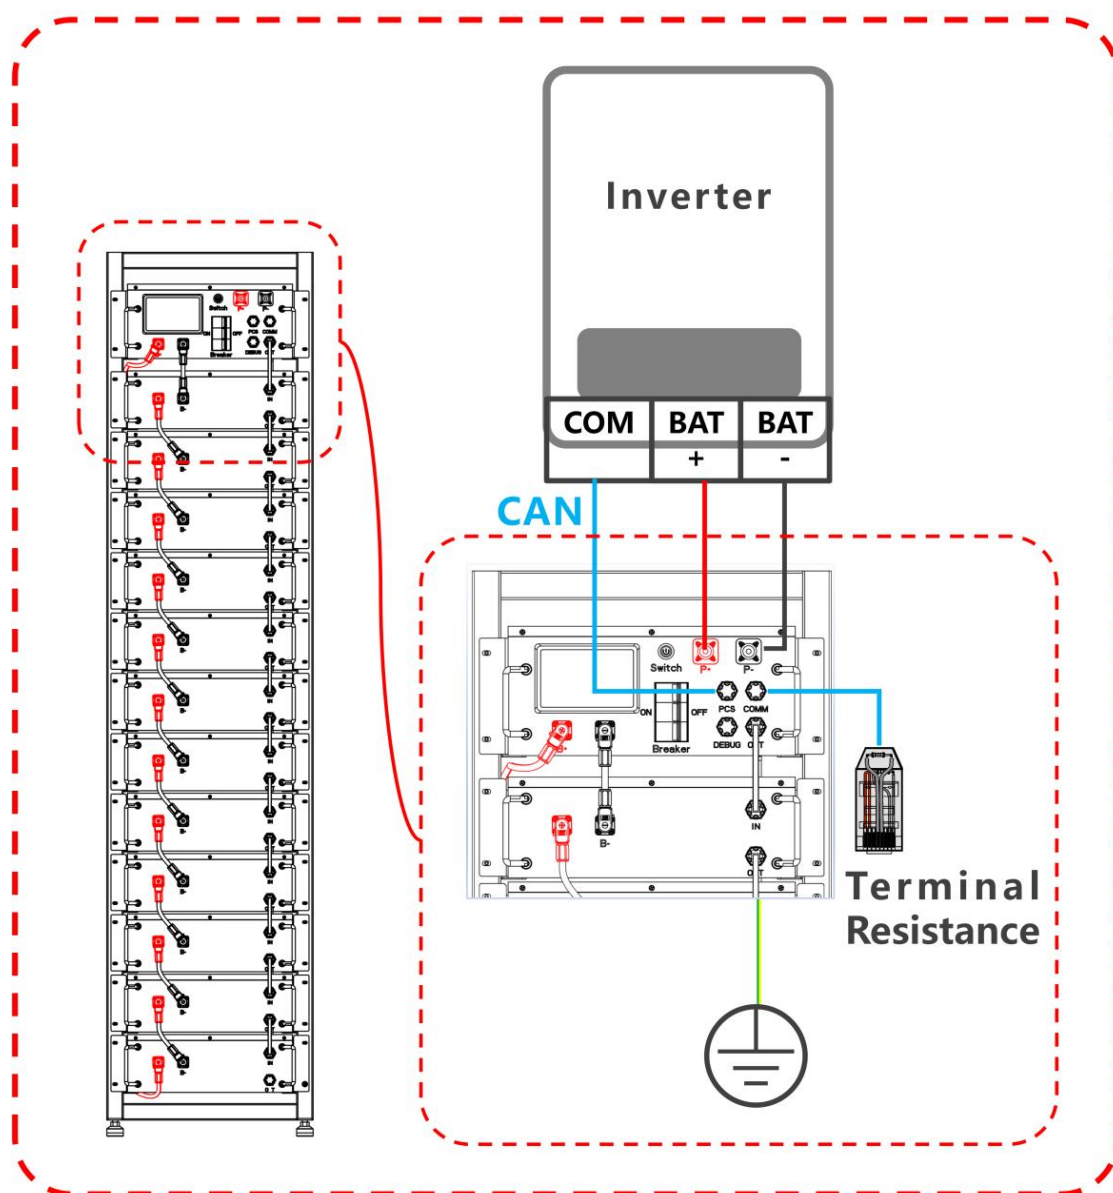


Figure 3.6.1


Notice:

- 1、 The DEBUG port is for debugging, please do not use this port when connecting the communication line ;
- 2、 Connect the PCS port to the inverter and install a terminal resistor on the COMM port ; note that the battery system will not operate normally if the terminal resistor is not installed .

3.6.2 Cluster Battery System


Notice:

1. The R60 battery system supports clustering of up to 5 battery systems ;
2. When clustering, the available power of each battery system must be consistent to ensure balanced and efficient operation of the system ;
3. Make sure the "PCS" communication port of battery system 1 is connected to the inverter . This is the port used to control the communication between the cluster battery system and the inverter .
4. Another "COMM" communication port of battery system 1 is used for battery cluster connection ;
5. For battery system N (N represents the last battery system) , make sure that the terminal resistor is installed on its "COMM" communication port ;
6. The DEBUG port is for debugging. Please do not use this port when connecting the communication line .

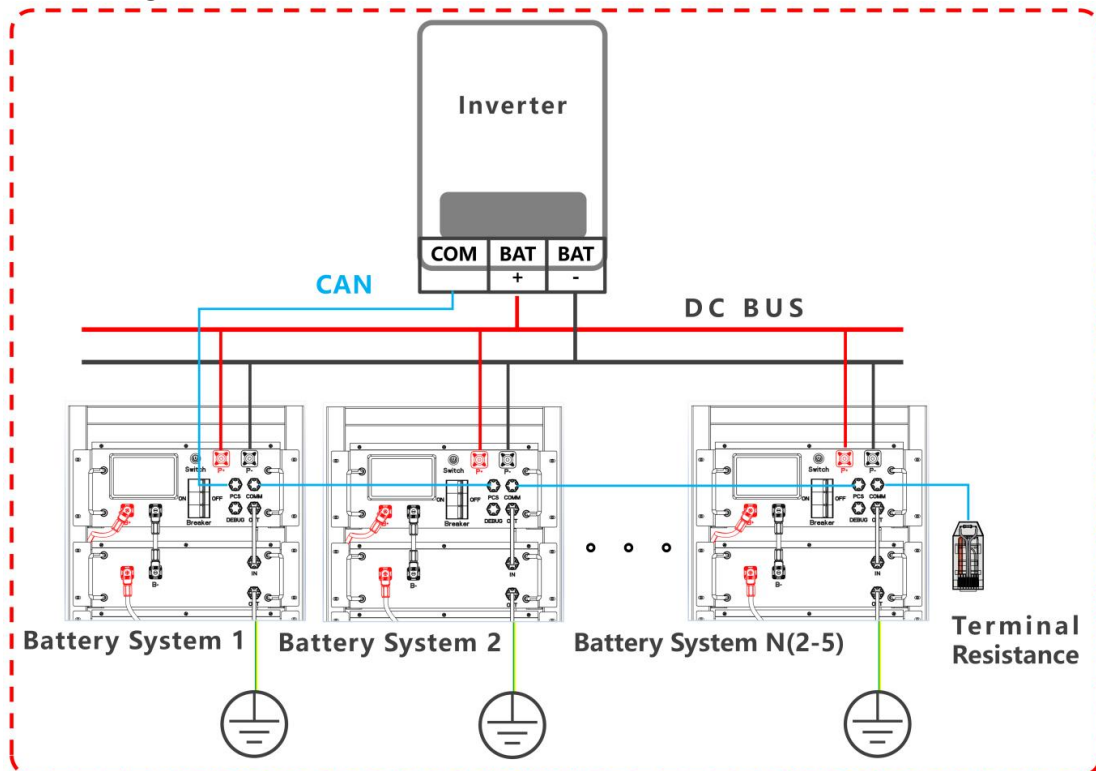


Figure 3.6.2



Illustrate:

Installing a terminal resistor is essential to maintain the integrity of the communication line signal, which can prevent signal reflection and attenuation. If the "COMM" port is not equipped with a terminal resistor, it may cause abnormal communication of the battery system, thus affecting the overall operation of the energy storage system.

3.6.3 Protective ground connection

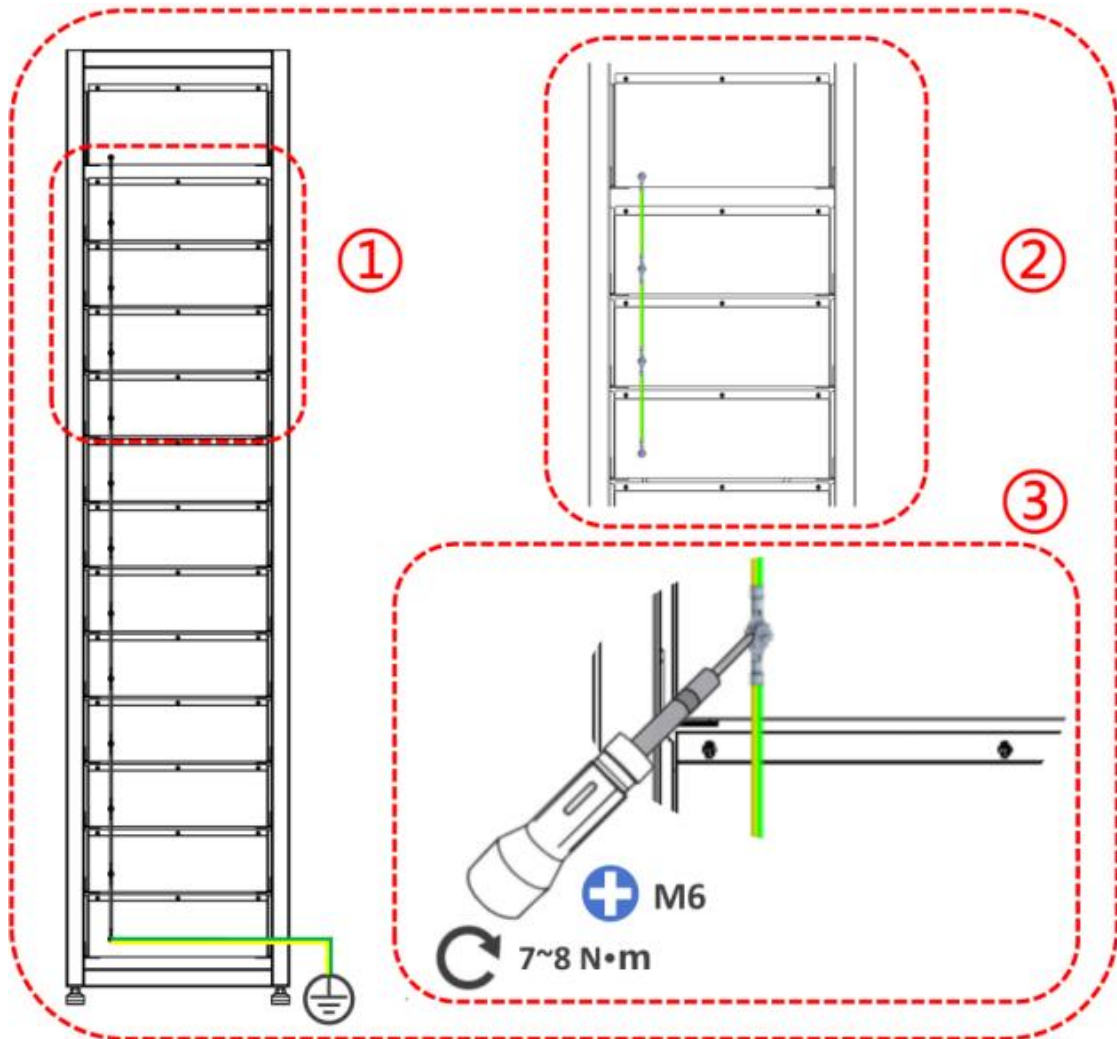


Figure 3.6.3



Notice:

1. Protective ground wire, recommended specifications: Type: outdoor single-core copper wire, conductor cross-sectional area: 6mm² ;
2. Make sure the cables are fixed and not loose after crimping.
3. After the battery stack is completed, the protective ground wire should be connected first to ensure safety, and when dismantling the battery system, the protective ground wire should be removed as the last step.

3.6.4 Power line connection

Battery pack power connection: (series)

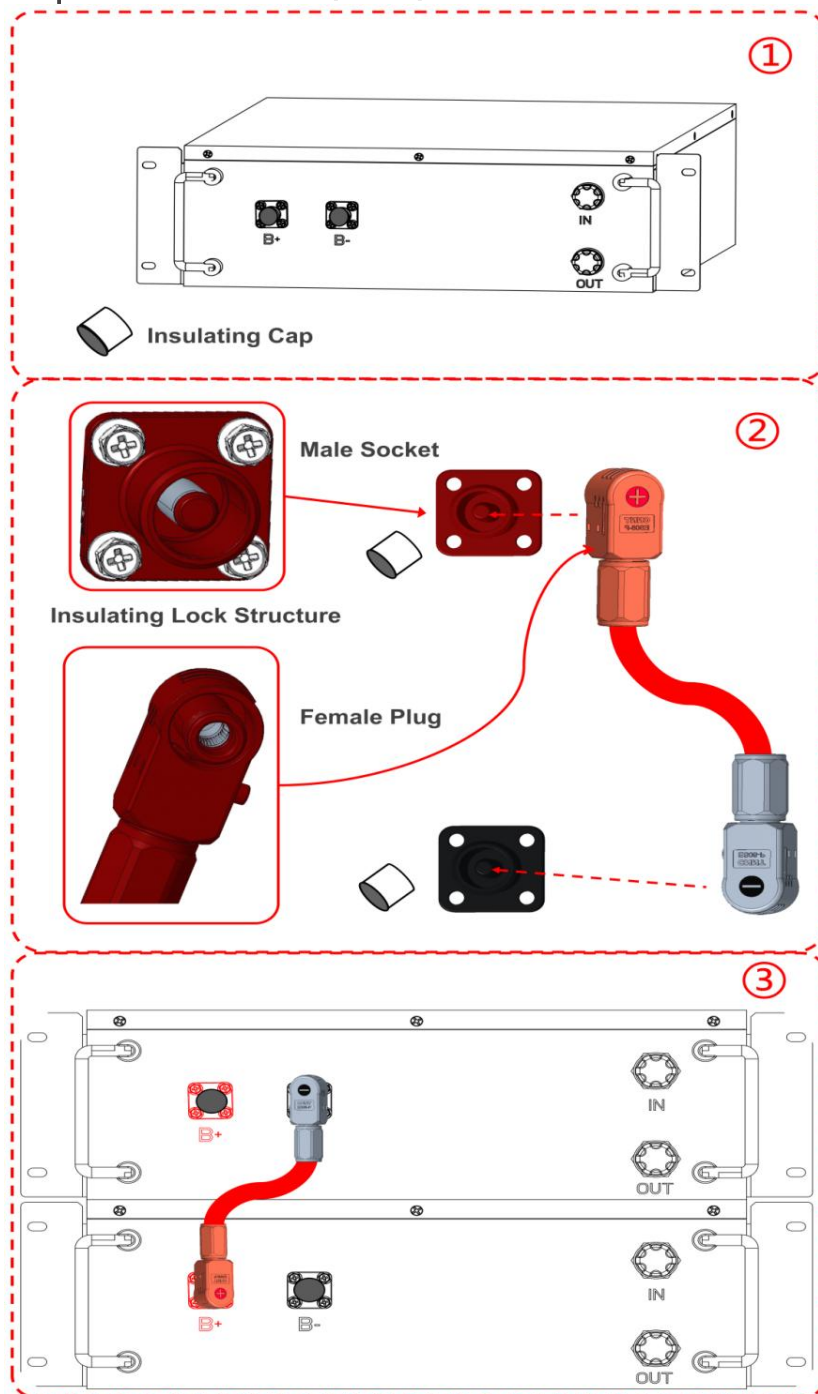


Figure 3.6.4-1



Illustrate:

During the battery module connection operation, you need to first remove the insulating protective caps installed at the B+ and B- ports of the battery system, and then quickly connect the upper and lower modules through the quick-plug connector.

Internal power line: (completed at the factory)

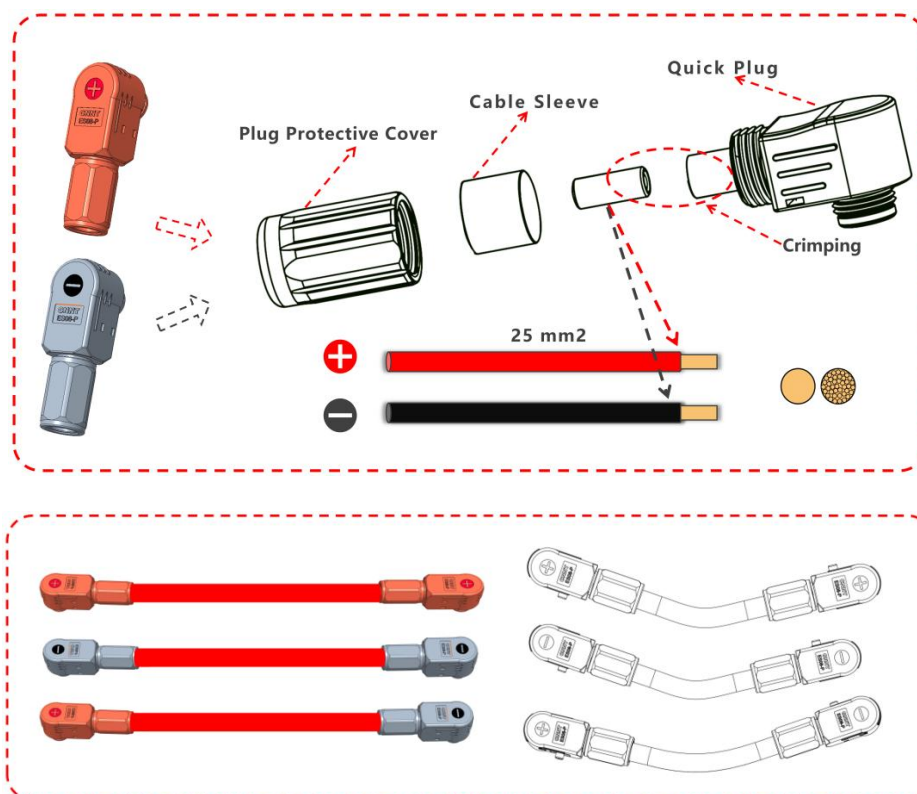


Figure 3.6.4-2

Battery pack power connection: (series)

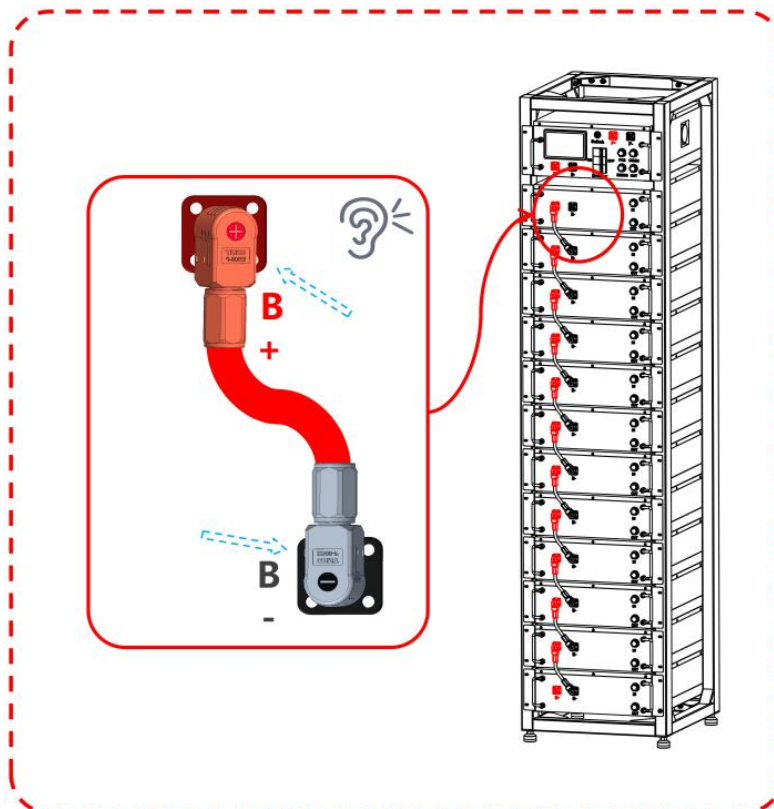


Figure 3.6.4-3

Battery pack communication connection: (BMU-daisy chain communication)

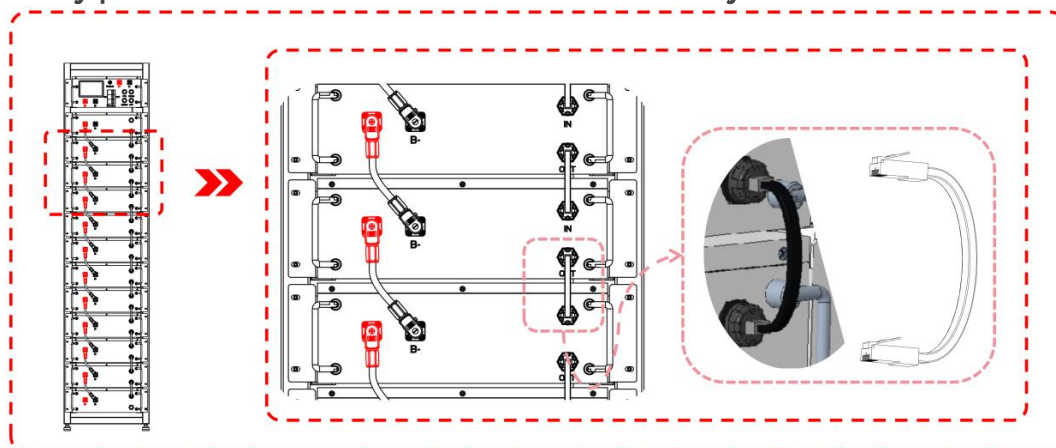


Figure 3.6.4-4

Battery Pack Communication Line Interface Definition Table

PIN	Interface	Name
1	IP-OUT	Daisy chain output positive
2	IM-OUT	Daisy chain output negative
1	IP-IN	Daisy chain input positive
2	IM-IN	Daisy chain input negative

Table 3.6.4

 **Note:** Daisy chain communication harness uses flat network cable;
Connection between battery box and control box:

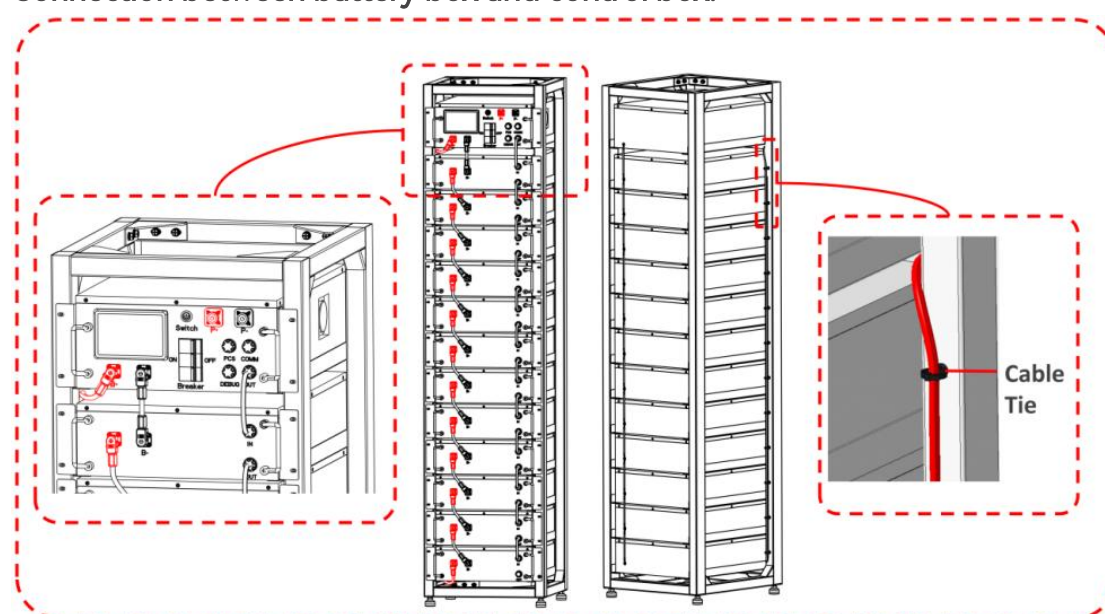


Figure 3.6.4-5

**Notice:**

1. "B+" on the high-voltage control box is connected to the positive pole of the battery box, and "B-" is connected to the negative pole of the battery box;
2. The "OUT" communication port on the high-voltage control box is the communication connection point between the BCU and BMU in the battery system;
3. The "B+" power connection line on the high-voltage control box needs to be tied with a cable tie at each battery box to secure the cable.

3.6.5 External communication line connection

**Notice:**

1. The user should decide whether to use the communication cable that comes with the inverter based on the installation requirements, and refer to the user manual for cable specifications and connection methods;
2. Purchase the communication cables yourself or ask the manufacturer to provide them . It is recommended to use standard Ethernet cables with RJ45 crystal connectors as the connection solution.

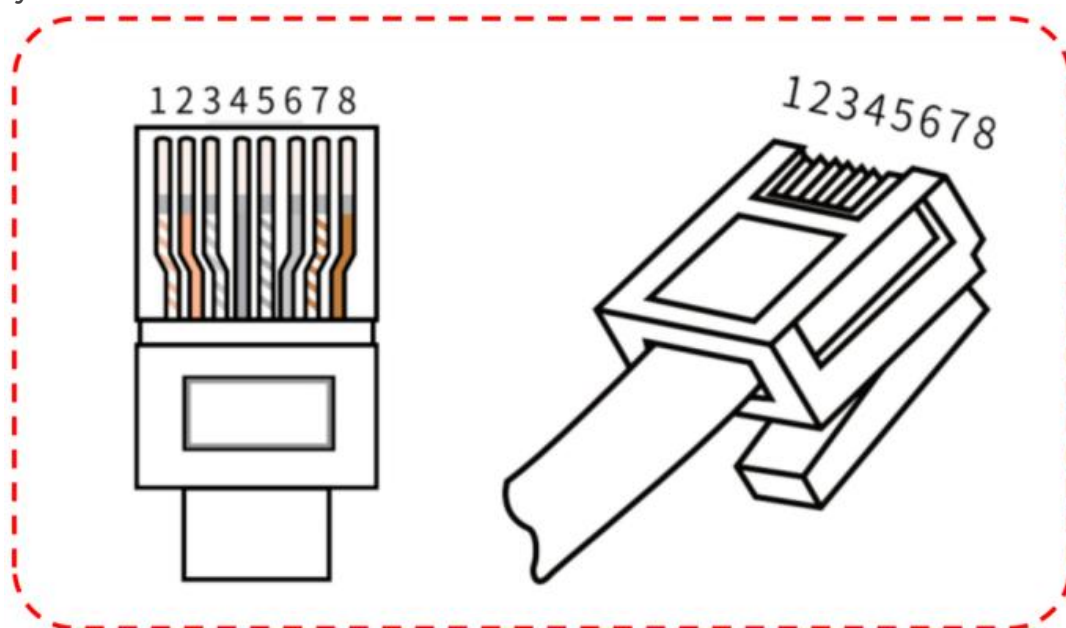


Figure 3.6.5

Port Definition Table

PIN	DEBUG	PCS	COMM
1	CAN0H	CAN0H	NC
2	CAN0L	CAN0L	NC
3	CAN1_GND	CAN1_GND	CAN1_GND

4	CAN1H	CAN1H	CAN1H
5	CAN1L	CAN1L	CAN1L
6	RS485G_1	DIH_IN2	HSS8
7	RS485A_1	GND	GND
8	RS485B_1	GND	GND

Table 3.6.5-1

Port Description Table

NO.	Name	illustrate
1	CAN0H CAN0L	Function debugging and upgrading
2	CAN1_GND CAN1H CAN1L	Connect to inverter communication or battery cluster communication
3	RS485G_1 RS485A_1 RS485B_1	Connect external RS485 communication equipment
4	DIH_IN2	High level signal input detection, i.e. battery cluster signal detection
5	HSS8	High-side switch output, i.e. parallel cluster signal output
6	GND	signal ground

Table 3.6.5-2

 **Note:** This chapter only explains the definition of the communication port. Be sure to install the battery system terminal resistor to avoid cluster faults and ensure the normal operation of the system .

3.6.6 External connection lines

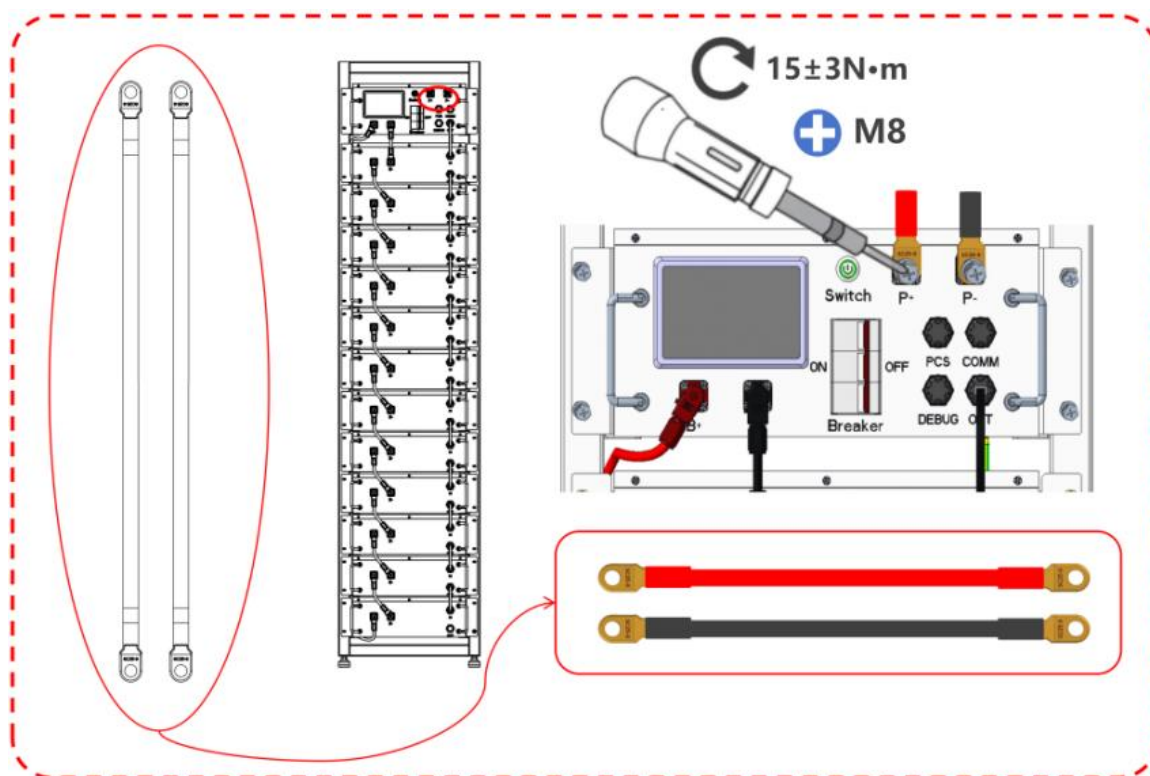


Figure 3.6.6

3.6.7 Electrical system connection

 **Note:** Refer to Appendix B.

04 Operation and maintenance



Danger:

Please use special protective equipment and special insulating tools to avoid electric shock or short circuit.



Notice:

1. During the power-on process, you should observe while powering on. If you find any abnormal phenomenon, immediately disconnect the battery and find out the cause. You can continue to power on after solving it.
2. After battery installation and commissioning, or when the battery is completely discharged, please recharge the battery in time, otherwise the battery may be damaged due to over-discharge.

4.1 Check before power on

Inspection items and acceptance criteria

NO.	Inspection items	Inspection Standards
1	System installed	Correct installation and firm and reliable
2	Reasonable cable layout	Reasonable cable layout to meet user requirements
3	Cable ties are beautiful	The cable ties should be evenly spaced and no sharp corners should be left at the cut
4	Reliable grounding	The ground connection is correct, firm and reliable
5	Disconnect switch	The "inverter" and all switches connected to the battery are in the "OFF" state
6	Cable connection in place	The DC line, AC line and communication line are connected correctly and firmly.
7	Seal unused terminals and connectors	Install waterproof covers on unused terminals and interfaces
8	The installation environment meets the requirements	Reasonable installation space and clean environment

Table 4.1

4.2 Boot steps

Step1: Use a multimeter to confirm that the grid voltage is within the predetermined range;

Step2: Close the circuit breaker between the inverter and the battery;

Step3: Close the circuit breaker on the high-voltage control box; the "Breaker" between each high-voltage box needs to be closed in sequence (order: from near to far, first close the main cluster-battery, then close the slave cluster battery);

Step4: Press the battery power button "SWITCH"; if it is a cluster system, before the first cluster, make sure that the voltage difference between the battery systems does not exceed 5V, then press the power button "SWITCH" between the battery systems one by one, and wait for 5 minutes for the stabilization period;

Step5: Please power on the inverter according to the instructions in the inverter user manual to start the inverter in the system.

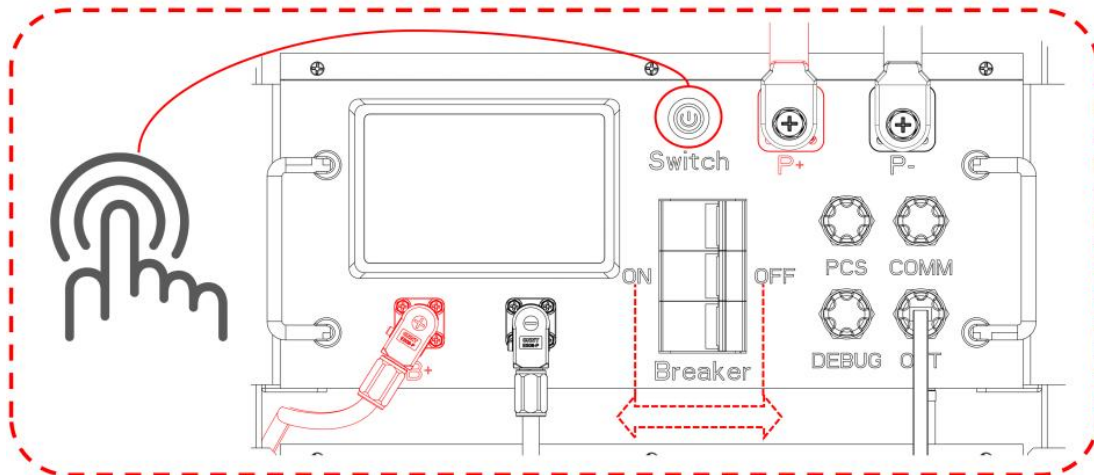


Figure 4.2-1

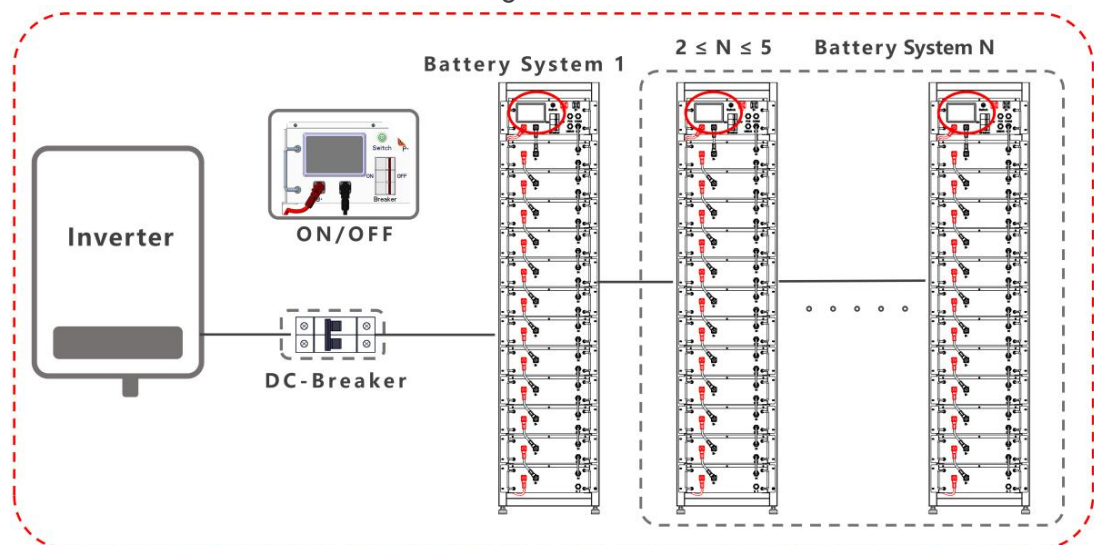


Figure 4.2-2

4.3 Shutdown steps



Danger:

When shutting down the battery system, please strictly follow the battery system power-off requirements to prevent damage to the battery system.

Step1: Please follow the instructions in the inverter user manual to perform power-off operations to shut down the inverter in the system;

Step2: In the cluster system, press the power button "SWITCH" on the battery system one by one to ensure that the indicator light of each "SWITCH" is off.

Step3: If it is a cluster-parallel system, the circuit breakers between the high-voltage control boxes need to be disconnected in sequence (sequence: from far to near, first close the slave cluster-battery, then close the master cluster battery);

Step4: Disconnect the circuit breaker between the inverter and the battery;



Illustrate:

After the system is shut down, the battery system safe disassembly instructions:

First, keep the power off for more than 10 minutes to ensure that the energy storage system is fully discharged;

Then use a multimeter to check and confirm that the inverter and battery system are not powered;

When removing the battery, after unplugging the quick-connect cable, the protective insulating cap must be immediately and tightly installed on the female sockets of the battery box and the high-voltage control box. The sealing structure establishes a physical isolation barrier between the live parts and the operating environment, blocking the risk of human contact with the live terminals.

4.4 Mobile APP



Note: After the battery system is powered on, you can view the detailed information of the battery on the "UDAN HESS" on the mobile phone.

Step 1: Download the "UDAN HESS" APP;

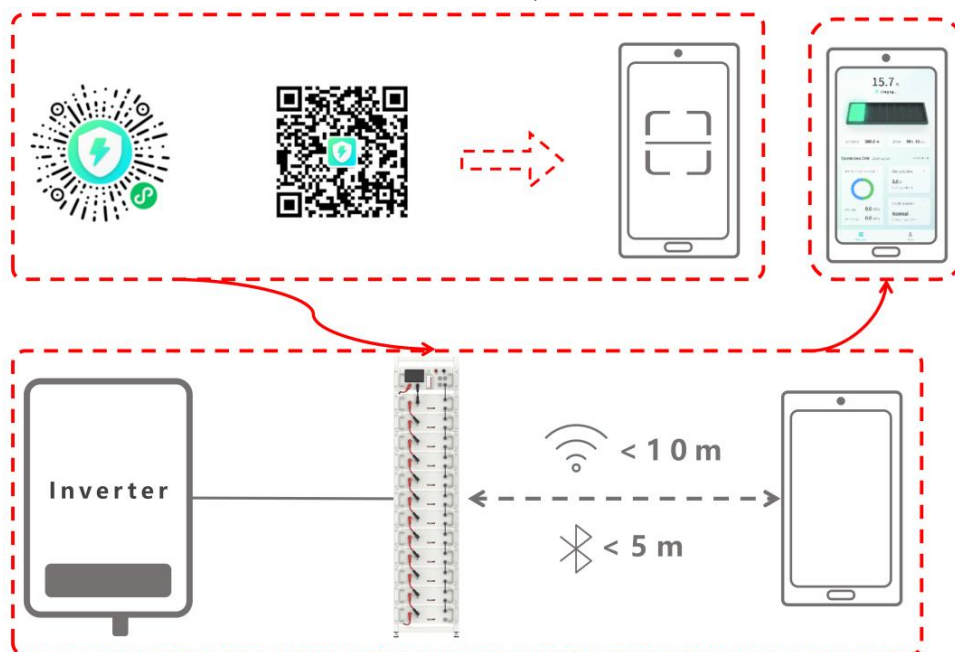


Figure 4.4-1

Step 2: Log in/register an account;

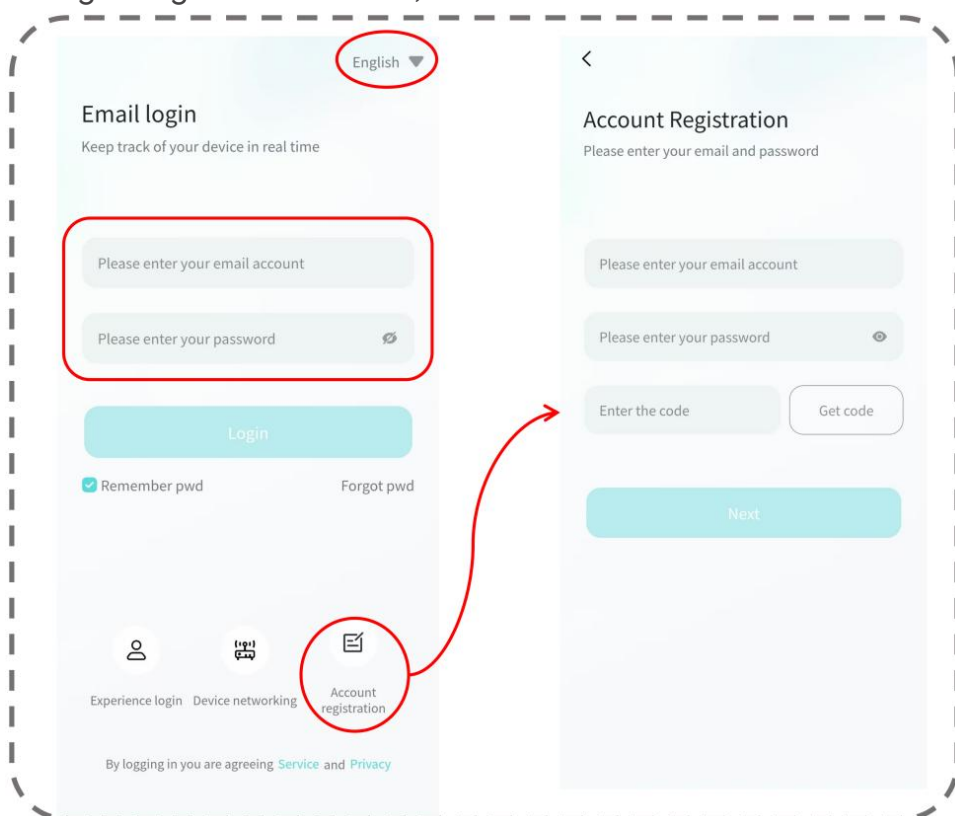


Figure 4.4-2

Step 3: Add device/connect device to the network;

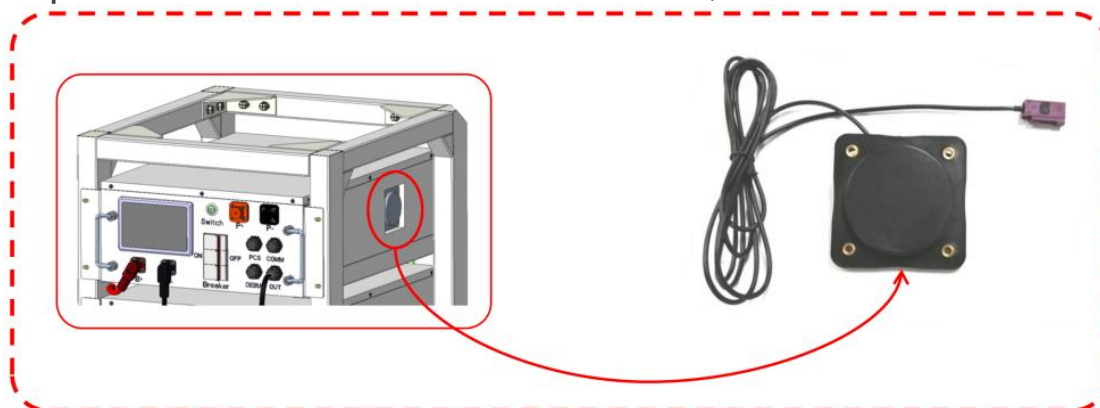


Figure 4.4-3



Description: GPRS special waterproof antenna developed for lithium battery pack, suitable for wireless data transmission;



Note: It is strictly forbidden to dismantle the antenna without permission, which may cause irreversible damage. The antenna must not be shielded by metal materials, and at least one direction must be unblocked, otherwise the signal strength will be affected.

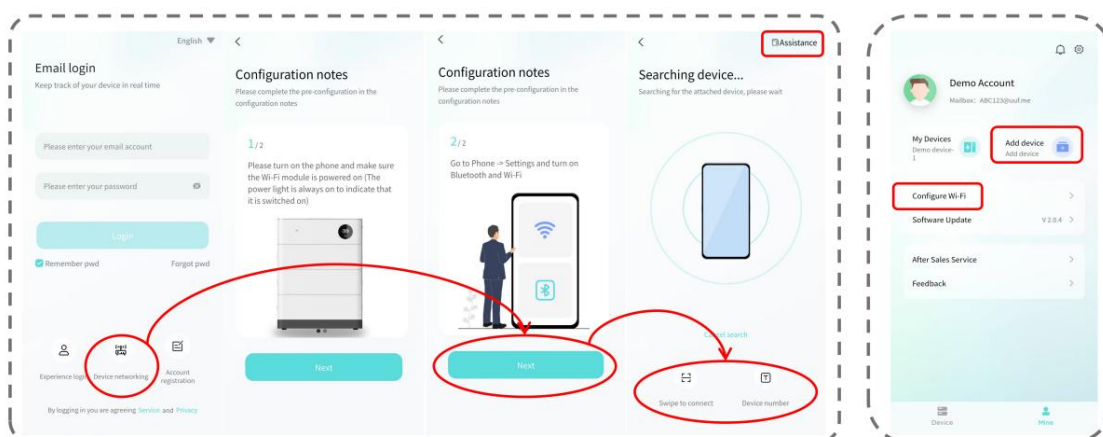


Figure 4.4-4



Note: Connect by scanning the QR code or inputting the device serial number to correctly configure the battery;



Note: This device does not support 5G band, so please make sure to connect to a WiFi network with 2.4G band.

Step 4: Check battery status;

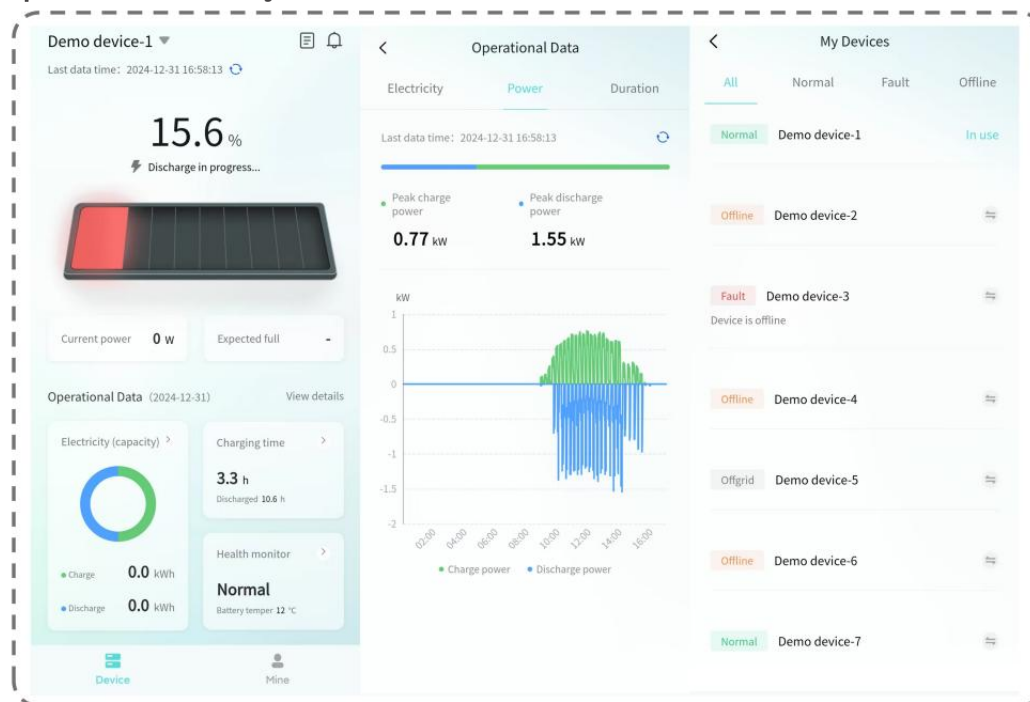


Figure 4.4-5

4.5 PC-side cloud platform

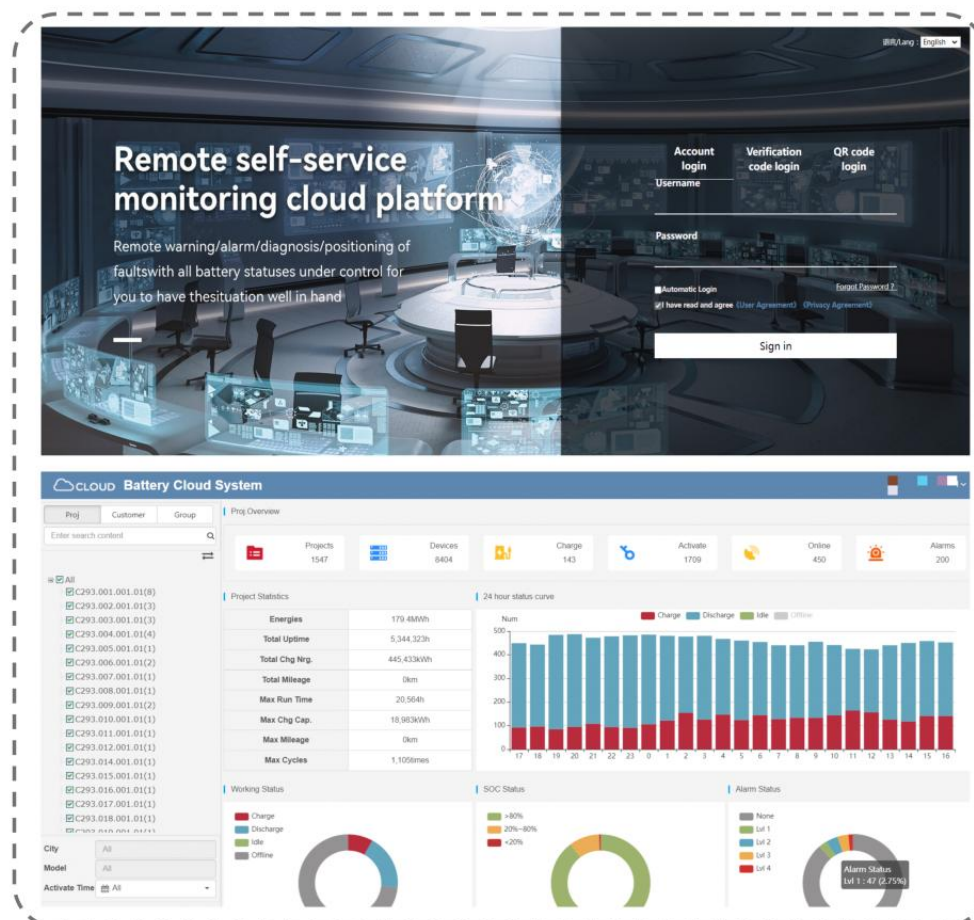


Figure 4.5

4.6 Battery Display

The first time you turn on the computer, you enter the main interface.

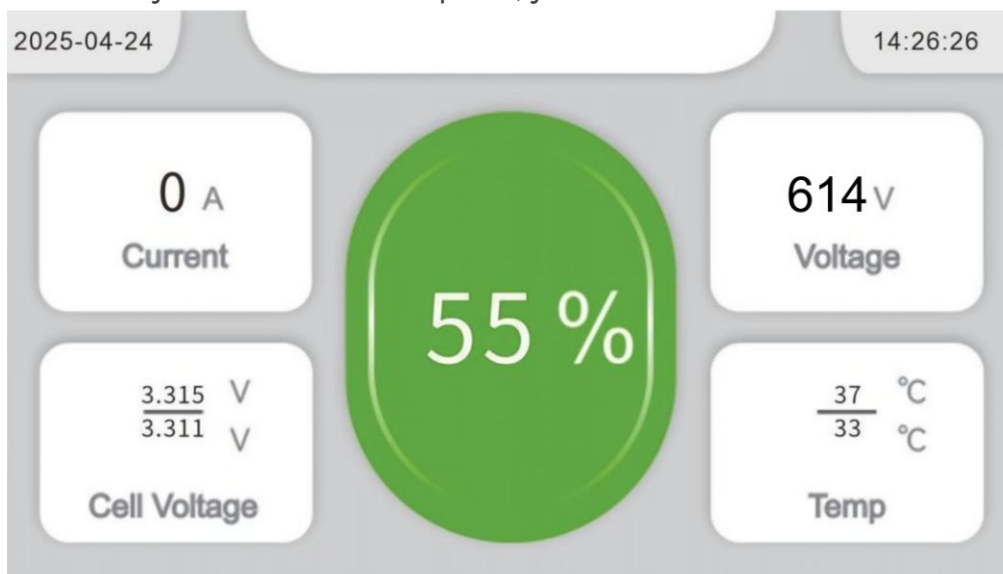


Figure 4.6-1

Entering the engineering interface, the date is displayed on the top left side, the fault is shown between the date and time, and the time is displayed on the right side; the total voltage, SOC, total current, maximum voltage, minimum voltage, maximum temperature, minimum temperature are shown in the middle; the bottom navigation menu is displayed, which can be switched to view the details of the interface.

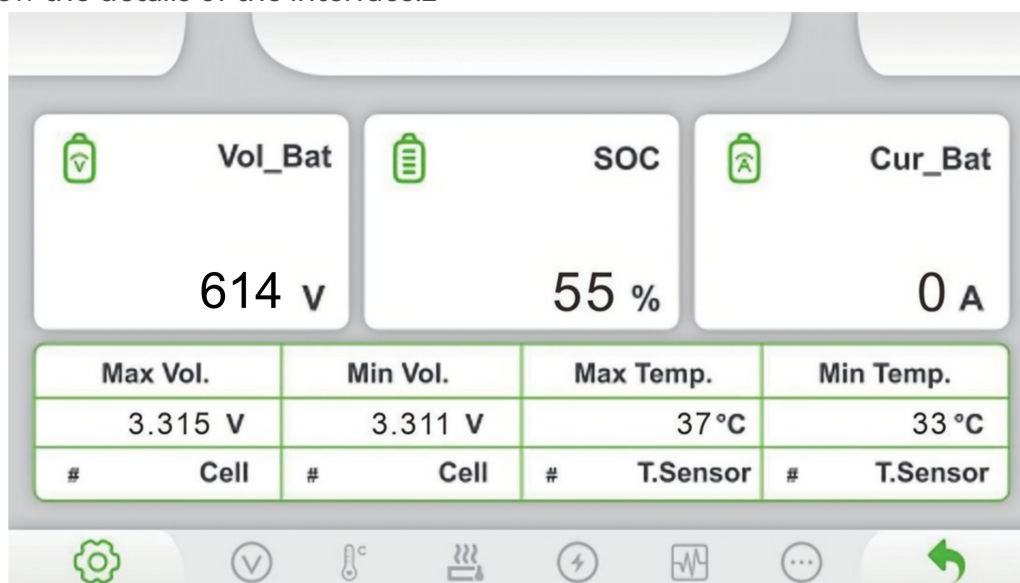


Figure 4.6-2

Click  to enter the voltage detail interface, you can swipe left and right to view each string of voltage value, click  to go back to the upper interface.

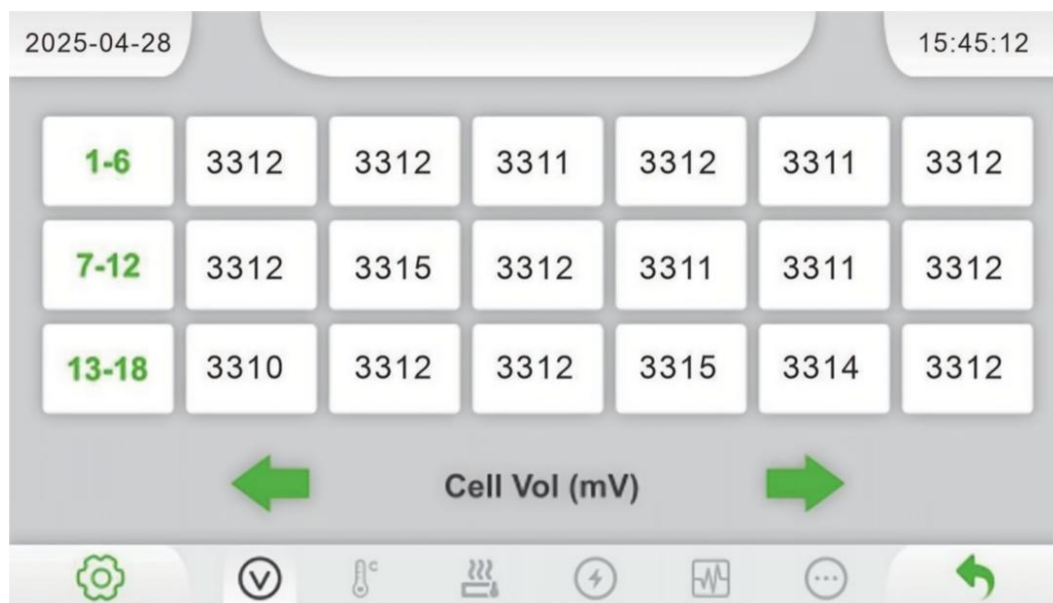


Figure 4.6-3

 **Note:** Battery Management System (BMS) information can be directly read and displayed on the display.

4.7 Battery Failure Handling

When the battery system fails, it may cause the system to shut down automatically or some functions to malfunction; please troubleshoot according to the following methods. If these troubleshooting cannot solve the problem, please contact the after-sales service center in time.



Notice:

When contacting after-sales service, please prepare the following information to quickly resolve the problem:

1. Battery information, such as serial number, software version, device installation time, fault occurrence time, fault occurrence frequency, etc.;
2. Equipment installation environment, such as weather conditions, etc. For installation environment recommendations, you can provide photos, videos and other documents to assist in analyzing the problem;
3. Equipment usage history, such as: frequency and duration of equipment use, number of times charged, maintenance status, etc., and also clearly specify the type of after-sales service, such as on-site repair, factory repair, or usage guidance.

Fault alarm processing table

Fault Name	Workaround
Charging cell voltage is high /Discharge cell voltage is high	After the battery has been idle for 0.5 hours, restart the discharge immediately.If the problem persists, please contact the after-sales service center

Charging cell voltage is low /Discharge cell voltage is low	After the battery has been idle for 0.5 hours, restart the discharge immediately.If the problem persists, please contact the after-sales service center
High total charging voltage /High total discharge voltage	After the battery has been idle for 0.5 hours, restart the discharge immediately.If the problem persists, please contact the after-sales service center
Total charging voltage is low /Total discharge voltage is low	Restart charging immediately after the battery has been idle for 0.5 hours.If the problem persists, please contact the after-sales service center
Charging single cell voltage difference /Discharge cell voltage difference	After restarting the battery, if the problem still exists, please contact the after-sales service center
Total charging voltage difference /Discharge total pressure difference	After restarting the battery, if the problem still exists, please contact the after-sales service center
High temperature during charging /High discharge temperature	1.Check the installation environment temperature to ensure that the battery system installation temperature meets the battery operating temperature range; 2.Turn off the battery and restart the system after the temperature returns to normal.
Charging at low temperature /Discharge low temperature	1.Check the installation environment temperature to ensure that the battery system installation temperature meets the battery operating temperature range; 2.Turn off the battery and restart the system after the temperature returns to normal.
Charging temperature difference /Discharge temperature difference	1.Check the installation environment temperature, ensure that the battery system installation temperature meets the battery operating temperature range, and compare the temperature on the display. 2.Turn off the battery, wait for the temperature to recover, and then turn on the device. If the problem persists, please contact the after-sales service center.
Slow charge overcurrent /Continuous discharge overcurrent	After waiting for 5 minutes, the system still fails to recover and needs to be restarted.If the problem persists, please contact the after-sales service center
SOC is too low	Restart the battery and charge it. If the problem persists, please contact the after-sales service center
Insulation leakage	Check whether the cable connections are normal, such as power lines, grounding lines, etc.If the problem persists, please contact the after-sales service center
Voltage cable leakage /Thermal sensor cable is missing	Please contact the after-sales service center

Intranet communication failure	Please contact the after-sales service center
Precharge failed	Please contact the after-sales service center
Abnormal current	Please contact the after-sales service center
BMS initialization failure	After restarting the battery, if the problem still exists, please contact the after-sales service center
Relay failure	Please contact the after-sales service center

Table 4.7



Warning: If any fault other than that in Table 4.7 occurs, please contact the after-sales service center directly.

4.8 Inspection and maintenance



Notice:

Energy storage equipment maintenance personnel must hold an electrician special operations operation certificate (China) or an electrician license that complies with local regulations, complete professional operation and maintenance training for energy storage systems, master operating specifications, and have complete electrical safety protection and emergency response capabilities.



warning:

- 1、 If you find any problem that may affect the battery system, please contact after-sales service immediately and do not disassemble it yourself;
- 2、 If you see the copper wire of the conductive wire exposed, do not touch it to avoid high voltage danger. Contact after-sales immediately. Do not disassemble it by yourself.
- 3、 In case of other emergencies, please contact after-sales immediately and follow their instructions, or wait for after-sales personnel to handle the situation on site.

Inspection and maintenance table

Maintenance content	Maintenance cycle
Check whether the battery system is loose. If so, tighten the corresponding position.	Every 6 months
Check if the shell is damaged. If so, please repaint it or contact the after-sales service center.	Every 6 months

Check whether the exposed wires are worn. If so, replace the corresponding cables.

Every 6 months

Check whether there is any debris around the battery to avoid affecting the heat dissipation of the battery.

Every 6 months

Check for water or pests to avoid long-term intrusion of the battery

Every 6 months

Table 4.8

4.9 Host computer monitoring



Notice:

1. Ensure that the host computer software used matches the battery system and is updated to the latest version;
2. Connect to the "DEBUG" port in the battery system to avoid connecting to the wrong port.



CAN Serial port communication device

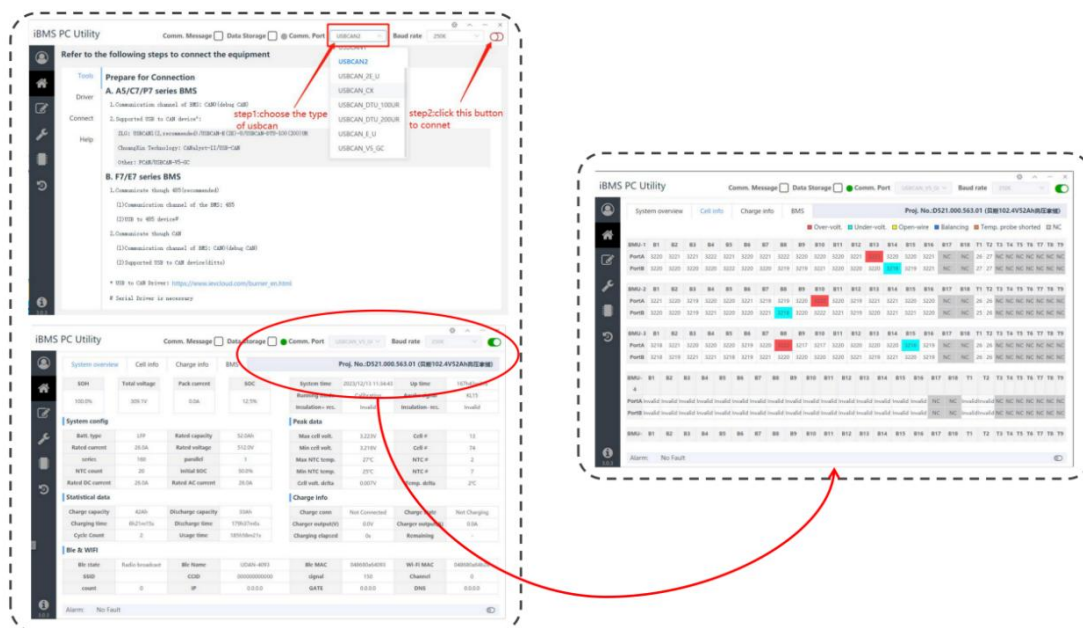


Figure 4.9

**Illustrate:**

After connecting the host computer to the battery system, users can monitor and extract a series of data covering the battery's SOC (state of charge percentage), SOH (healthy state percentage), etc.; including the total voltage of the battery system, the voltage of each cell, the total current, and the current data during charging and discharging. At the same time, users can also obtain the temperature of the battery cells and the whole, as well as the battery's usage history, such as the number of charge and discharge cycles, and the accumulated charge and discharge amount. Battery safety information, such as fault codes and insulation status, is also queryable. In addition, users can access detailed information on the system configuration and upgrade and debug the equipment.

05 Warranty Service

5.1 Warranty Period

In case of correct use of the product, the warranty period agreed in the commercial contract shall prevail.

5.2 Warranty Scope

During the warranty period, if the product is caused by quality problems, our company will repair or replace the product for free. Customers should reserve a reasonable response time for our company's repair, and the replaced product will be handled by our company. Customers need to show relevant proof of purchase of the product and ensure that the product trademark is clearly visible, otherwise our company has the right to not provide warranty guarantee.

5.3 Disclaimer

In the following situations, our company has the right not to provide quality assurance, but can still provide paid maintenance services.

1. The warranty period has expired;
2. Failure to provide relevant proof of product purchase;
3. Damage caused during transportation, loading and unloading;
4. Damage caused by improper installation, modification or dismantling by unauthorized personnel;
5. Damage caused by operation under abnormal conditions or environment;
6. Machine failure or damage caused by using non-Natong parts or software;
7. Failure caused by force majeure such as fire, earthquake, flood, etc.

Appendix

Appendix A – Emergency Handling

When the battery falls or is severely impacted

If the battery falls or is severely impacted during installation, internal damage may occur. It is strictly forbidden to continue using it.

If there is a obvious odor, damage, smoke or fire, immediately evacuate people and call the police in time. Professionals should use fire-fighting facilities to put out the fire and take other measures under the premise of ensuring safety.

If there is no obvious deformation or damage in appearance, and no obvious odor, smoke or fire, contact professionals to transfer the battery to an open and safe place, or contact the company for recycling.

In case of flood

Under the premise of ensuring personal safety, power off the system immediately.

If any part of the battery is submerged in water, do not touch it to prevent electric shock. Evacuate the scene and report in time.

Flooded batteries are at risk of electrolyte contamination and cannot be reused. They need to be recycled and scrapped by professional institutions.

When there is smoke or fire

It is strictly forbidden to open the door and enter when there is a lot of smoke in the battery storage room to prevent the risk of explosion and personnel inhaling toxic gases.

During the fire fighting process, all rescuers should wear fully insulated fire-proof clothing, fire-fighting filter-type gas masks or air respirators, fire helmets and face masks, insulated shoes and other insulating protective devices. Use inert gas or Class D dry powder fire extinguishers. Do not use water-based fire extinguishing agents (in the initial stage).

After the open fire is put out, it is still necessary to continue spraying water for cooling until the battery temperature drops to within $\pm 10^{\circ}\text{C}$ of room temperature, and monitor for several hours to ensure that there is no sign of temperature rise before dismantling.

In case of electric shock

Set up a warning tape to isolate the scene and ensure that people stay away from the power source.

Do not directly touch the injured person before they are disconnected from the power source to avoid being electrocuted yourself. Wear professional insulating gloves/shoes and use insulating tools to separate the electrocuted person from the power source.

Call the emergency number immediately if the injury is serious. Let the injured person lie flat and monitor changes in their consciousness, breathing and heartbeat. For those in serious condition/without breathing/heartbeat, certified/trained personnel should perform cardiopulmonary resuscitation until medical staff arrive.

When the battery bulges

Immediately stop using and power off the battery, stop charging and discharging, and disconnect the device power. Do not attempt to charge, freeze or puncture the battery. If the device is found to be heating up or smoking, place it in a fireproof container (metal box/sandbox) and keep away from the device.

Reference for the degree of battery bulging and handling methods:

- (1) Slight deformation, no heat—take it out safely and send it to a recycling point
- (2) Shell rupture/leakage—isolated and handed over to hazardous waste institutions for disposal
- (3) Accompanied by high temperature/smoke — place in a sandbox for monitoring, cool with water and call the police.

Personal safety shall be the primary principle in all operations. If you are unsure, evacuate immediately and contact professionals


Appendix B-Marking Description

Identification Instructions	
	Please read the endorsed documentation carefully
	Danger. Risk of electric shock!
	Hazardous Substance Labeling
UN38.3	Transportation Safety Certification
	Flammability risk
	Keep the battery away from open flame or ignition sources.
	Recycling
	The danger of voltages. Danger to life due to high voltages in the energy storage system
	This marking indicates that this product should not be disposed with other household wastes

Appendix C – System Connection Diagram



illustrate:

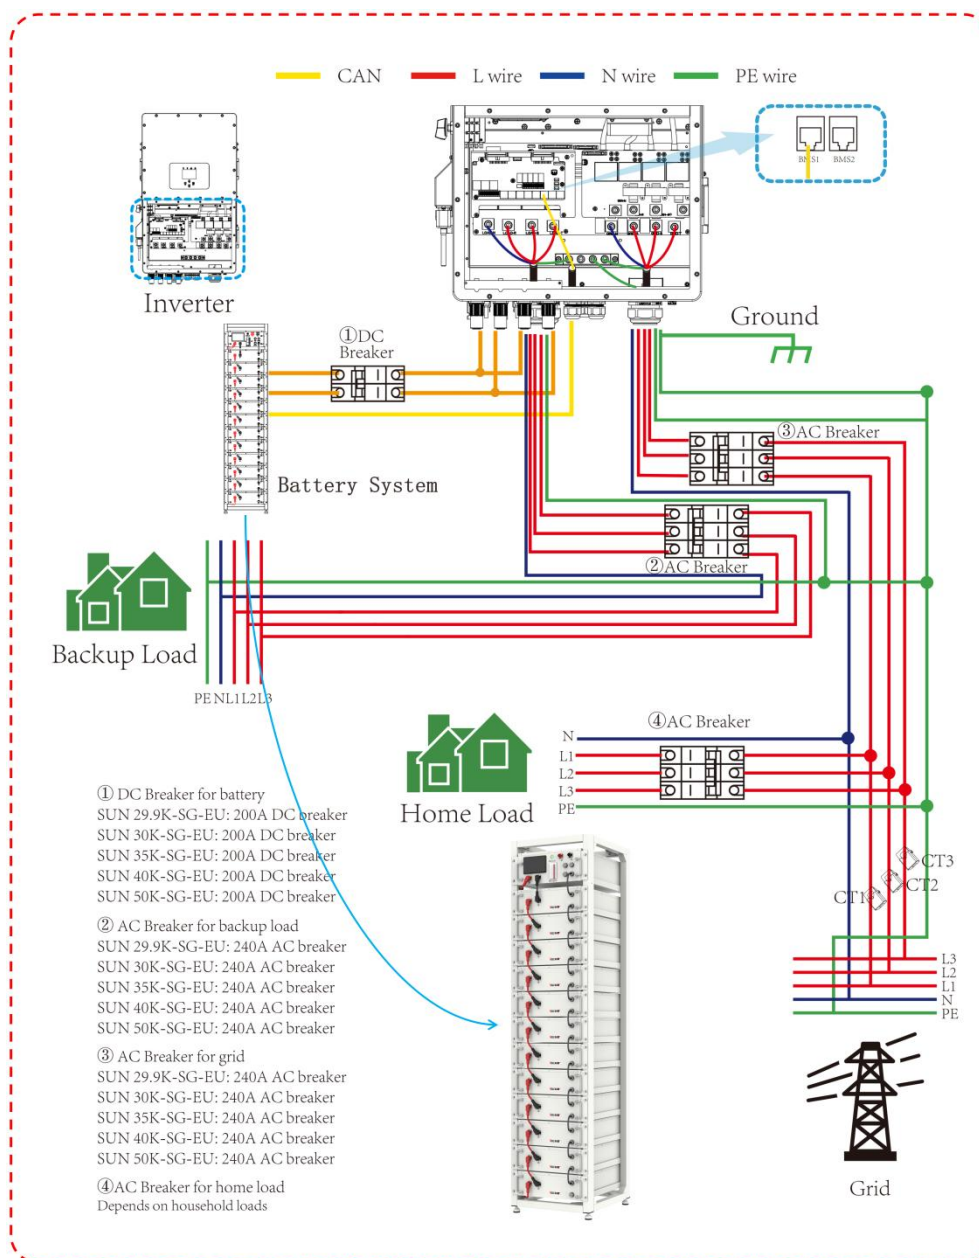

The figure shows the electrical system connection between the Deye inverter "SUN-29.9-50K-SG01LP3-EU-BM3" series and the "R60" battery; for detailed information and operating instructions of the inverter, please refer to the "Deye" user manual.



User Manual

BSL NEW ENERGY TECHNOLOGY CO., LTD

www.bsl-battery.com
inquiry@bsl-battery.com

Follow us on:     

Add: Building 2, Area D, Qunyi Intelligent
Manufacturing Industrial Park, Tonghu
Ecological Intelligence Zone, Zhongkai,
Huizhou, Guangdong, China

Website



Tiktok



Youtube

